

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15745

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-53

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	<0.001	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

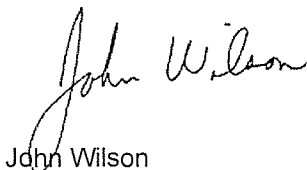

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15746

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-97

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No **Field Residual Chlorine:**

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	<0.001	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

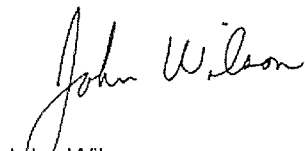

John Wilson
 Environmental Laboratory Supervisor and contact person
 If you have questions, please call.
 (518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15747

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
 Owner: Chatham Central School
 Sample Loc: Chatham Elementary School
 Sample Pt: MED-F-40

Collect Date: 09/01/2016
 Collect Time: 06:00
 Collected by: M. NIEMEYER
 Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.004	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

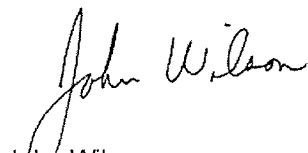

John Wilson
 Environmental Laboratory Supervisor and contact person
 If you have questions, please call.
 (518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: **AW15748**

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
 Owner: Chatham Central School
 Sample Loc: Chatham Elementary School
 Sample Pt: MED-F-19

Collect Date: 09/01/2016
 Collect Time: 06:00
 Collected by: M. NIEMEYER
 Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.013	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

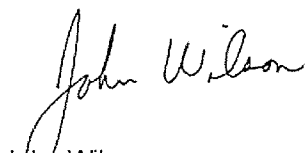

John Wilson
 Environmental Laboratory Supervisor and contact person
 If you have questions, please call.
 (518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15749

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-92

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.014	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

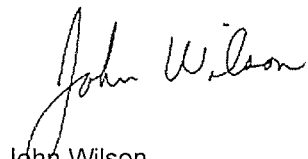

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15750

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-89

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.053	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

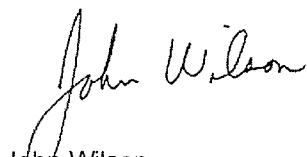

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15751
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-13

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.005	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

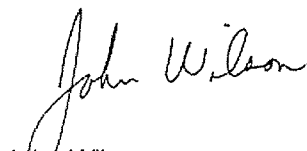

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15752
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-131

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.052	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

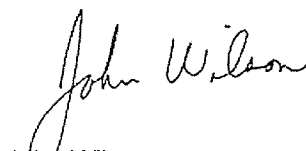

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15753

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-133

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.004	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

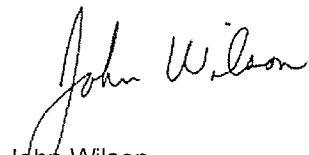

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15754

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-110

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.005	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.



John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15755

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-130Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

L a b o r a t o r y R e p o r t

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.030	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

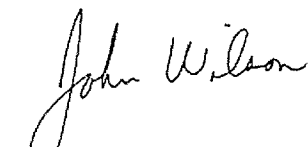John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15756

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-11

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.005	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.



John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: **AW15757**
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-101

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No Field Residual Chlorine:

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.025	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

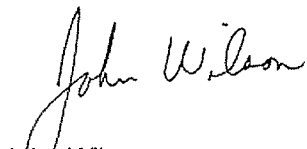

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15758
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-72

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.002	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

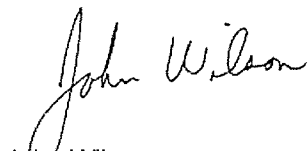

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15760

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-135

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.003	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

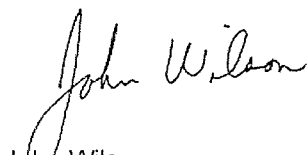

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15761
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-140

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.150	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

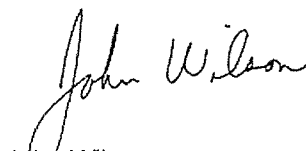

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15762

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-139

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	<0.001	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

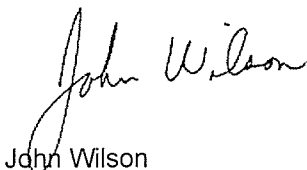

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave**Chatham, NY 12037****Printed On** 9/8/2016 Page 1 of 1**Sample ID:** AW15763
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:**Customer:** Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-100**Collect Date:** 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1**Water Source:**
Chlorinated: No **Field Residual Chlorine:****Potability:** Yes
Grab/Comp: Grab**Laboratory Report**

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.038	0.015	X	mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					


Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB

If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.**Note 1:** Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.**Comments:**

Test procedures for all analyses meet NELAC requirements.

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479**Reviewed by Brian Collins**
These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15764
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-102

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.067	0.015	X	mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

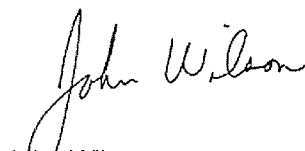

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15765
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-77

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.036	0.015	X	mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

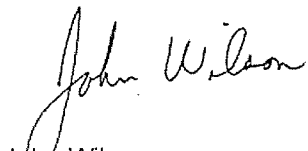

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15766

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-F-81

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.016	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

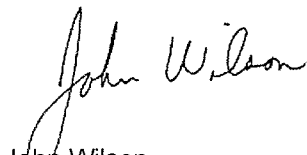

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15767

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-DW-10

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.007	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or
National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable
bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between
0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.



John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15768
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-DW-12

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No Field Residual Chlorine:

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.004	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

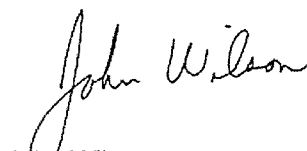

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15769

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-DW-78

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.031	0.015	X	mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

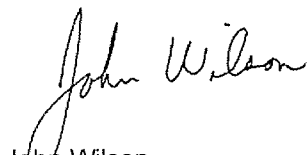

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15770

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-DW-82

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.018	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

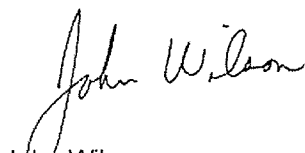

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15771
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Elementary School
Sample Pt: MED-DW-71

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.003	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.



John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15774
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-F-131

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.016	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

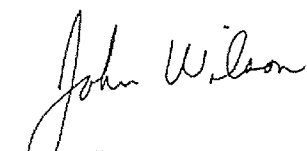

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15775

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham Middle School

Sample Pt: MS-F-120

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	<0.001	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X Exceeds maximum contamination limit

T Temperature outside specifications

P Sample preserved at lab

S(+/-) Lab control sample outside acceptance limits

(+ Result may be biased high / - Result may be biased low)

R Duplication outside acceptance limits

A Sample contained air bubble or headspace

Z Analysis is not state-certified

M(+/-) Matrix spike recovery outside acceptance limits

H Hold time exceeded

B Analyte detected in blank

C Incorrect bottle received

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

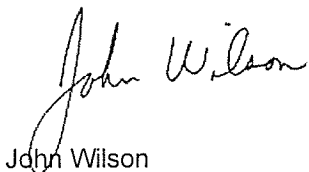

John Wilson

Environmental Laboratory Supervisor and contact person

If you have questions, please call.

(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15776

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham Middle School

Sample Pt: MS-F-71

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.016	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

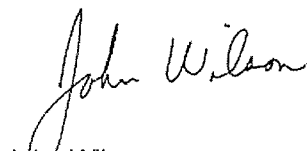John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15777

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham Middle School

Sample Pt: MS-F-80

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.017	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15778

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham Middle School

Sample Pt: MS-F-69

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.012	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.



John Wilson

Environmental Laboratory Supervisor and contact person

If you have questions, please call.

(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15780
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-F-35

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.008	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

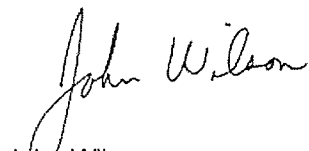

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15781
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:**Customer:** Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-F-36**Collect Date:** 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1**Water Source:**
Chlorinated: No **Field Residual Chlorine:****Potability:** Yes
Grab/Comp: Grab**Laboratory Report**

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.006	0.015		mg/l	SM3113B	MN	9/7/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)


Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB

If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.**Note 1:** Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.**Comments:**

Test procedures for all analyses meet NELAC requirements.

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479**Reviewed by Brian Collins**

These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15782

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham Middle School

Sample Pt: MS-F-62

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.012	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit

T Temperature outside specifications

P Sample preserved at lab

S(+/-) Lab control sample outside acceptance limits

(+ Result may be biased high / - Result may be biased low)

R Duplication outside acceptance limits

A Sample contained air bubble or headspace

Z Analysis is not state-certified

M(+/-) Matrix spike recovery outside acceptance limits

H Hold time exceeded

B Analyte detected in blank

C Incorrect bottle received

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

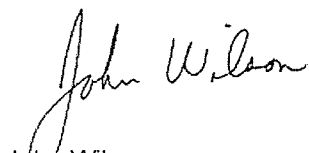

John Wilson

Environmental Laboratory Supervisor and contact person

If you have questions, please call.

(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15783
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-F-79

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.012	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

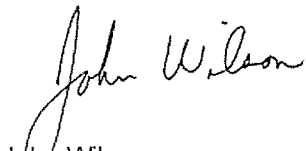

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15784

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham Middle School

Sample Pt: MS-F-37

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.007	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit

T Temperature outside specifications

P Sample preserved at lab

S(+/-) Lab control sample outside acceptance limits

(+ Result may be biased high / - Result may be biased low)

R Duplication outside acceptance limits

A Sample contained air bubble or headspace

Z Analysis is not state-certified

M(+/-) Matrix spike recovery outside acceptance limits

H Hold time exceeded

B Analyte detected in blank

C Incorrect bottle received

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

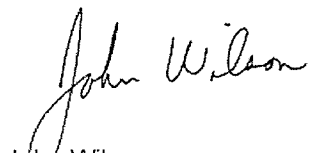

John Wilson

Environmental Laboratory Supervisor and contact person

If you have questions, please call.

(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15785
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-F-34

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.005	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

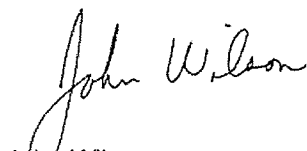

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15786
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-DW-60

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.009	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

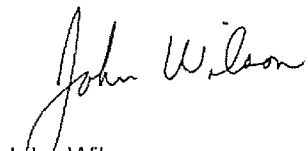

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1**Sample ID:** AW15787
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:**Customer:** Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-DW-68**Collect Date:** 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1**Water Source:**
Chlorinated: No **Field Residual Chlorine:****Potability:** Yes
Grab/Comp: Grab**L a b o r a t o r y R e p o r t**

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.028	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

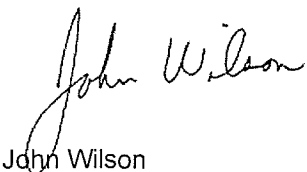

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15788

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham Middle School

Sample Pt: MS-DW-59

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.004	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit

T Temperature outside specifications

P Sample preserved at lab

S(+/-) Lab control sample outside acceptance limits

(+ Result may be biased high / - Result may be biased low)

R Duplication outside acceptance limits

A Sample contained air bubble or headspace

Z Analysis is not state-certified

M(+/-) Matrix spike recovery outside acceptance limits

H Hold time exceeded

B Analyte detected in blank

C Incorrect bottle received

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

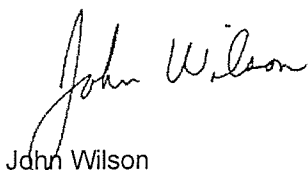

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15789
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham Middle School
Sample Pt: MS-DW-24

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.018	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

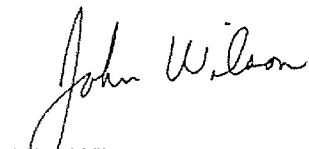

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15790
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham High School
Sample Pt: HS-F-100

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.081	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

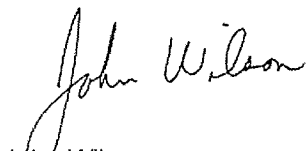

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15791

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham High School

Sample Pt: HS-F-59

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

L a b o r a t o r y R e p o r t

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.010	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit

T Temperature outside specifications

P Sample preserved at lab

S(+/-) Lab control sample outside acceptance limits

(+ Result may be biased high / - Result may be biased low)

R Duplication outside acceptance limits

A Sample contained air bubble or headspace

Z Analysis is not state-certified

M(+/-) Matrix spike recovery outside acceptance limits

H Hold time exceeded

B Analyte detected in blank

C Incorrect bottle received

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

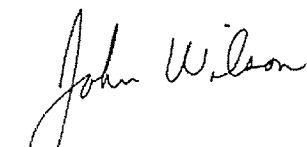

John Wilson

Environmental Laboratory Supervisor and contact person

If you have questions, please call.

(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham, NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15792
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham High School
Sample Pt: HS-F-42

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No Field Residual Chlorine:

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.002	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level-referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

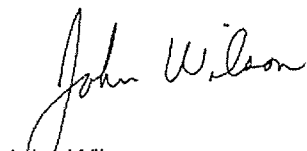

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1
Sample ID: **AW15793**
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham High School
Sample Pt: HS-F-31

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

L a b o r a t o r y R e p o r t

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.010	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

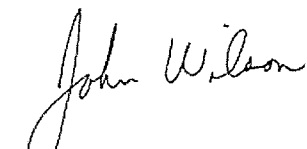

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15794

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham High School

Sample Pt: HS-F-96

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.019	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15795
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham High School
Sample Pt: HS-F-45

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

L a b o r a t o r y R e p o r t

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	<0.001	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

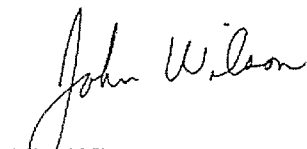

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15796
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham High School
Sample Pt: HS-F-30

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.007	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		
(+ Result may be biased high / - Result may be biased low)					

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

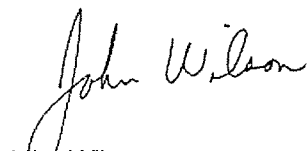

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins
These results relate to samples as received.

Chatham Central School

50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016

Page 1 of 1

Sample ID: AW15797

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham High School

Sample Pt: HS-F-92

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No Field Residual Chlorine:

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.120	0.015	X	mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit

T Temperature outside specifications

P Sample preserved at lab

S(+/-) Lab control sample outside acceptance limits

(+ Result may be biased high / - Result may be biased low)

R Duplication outside acceptance limits

A Sample contained air bubble or headspace

Z Analysis is not state-certified

M(+/-) Matrix spike recovery outside acceptance limits

H Hold time exceeded

B Analyte detected in blank

C Incorrect bottle received

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

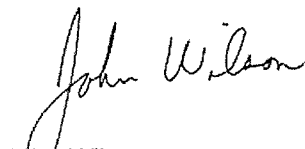John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15799
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham High School
Sample Pt: HS-DW-81

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.040	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X	Exceeds maximum contamination limit	R	Duplication outside acceptance limits	H	Hold time exceeded
T	Temperature outside specifications	A	Sample contained air bubble or headspace	B	Analyte detected in blank
P	Sample preserved at lab	Z	Analysis is not state-certified	C	Incorrect bottle received
S(+/-)	Lab control sample outside acceptance limits	M(+/-)	Matrix spike recovery outside acceptance limits		

(+ Result may be biased high / - Result may be biased low)

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

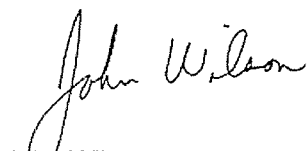

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15800

Date Received: 09/01/2016

Time Received: 10:40

Date Finalized: 09/08/2016

PO Number:

Your Ref:

Customer: Chatham Central School

Owner: Chatham Central School

Sample Loc: Chatham High School

Sample Pt: HS-DW-83

Collect Date: 09/01/2016

Collect Time: 06:00

Collected by: M. NIEMEYER

Receipt Temp: 24 C see note 1

Water Source:

Chlorinated: No *Field Residual Chlorine:*

Potability: Yes

Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.008	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit

T Temperature outside specifications

P Sample preserved at lab

S(+/-) Lab control sample outside acceptance limits

(+ Result may be biased high / - Result may be biased low)

R Duplication outside acceptance limits

A Sample contained air bubble or headspace

Z Analysis is not state-certified

M(+/-) Matrix spike recovery outside acceptance limits

H Hold time exceeded

B Analyte detected in blank

C Incorrect bottle received

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.

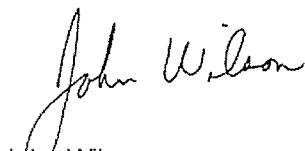

John Wilson
Environmental Laboratory Supervisor and contact person
If you have questions, please call.
(518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.

Chatham Central School
50 Woodbridge Ave

Chatham ,NY 12037

Printed On 9/8/2016 Page 1 of 1

Sample ID: AW15801
Date Received: 09/01/2016
Time Received: 10:40
Date Finalized: 09/08/2016
PO Number:
Your Ref:

Customer: Chatham Central School
Owner: Chatham Central School
Sample Loc: Chatham High School
Sample Pt: HS-DW-46

Collect Date: 09/01/2016
Collect Time: 06:00
Collected by: M. NIEMEYER
Receipt Temp: 24 C see note 1

Water Source:
Chlorinated: No **Field Residual Chlorine:**

Potability: Yes
Grab/Comp: Grab

Laboratory Report

Test	Result	MCL	Qualifiers	Units	Method Used	Analyst	Analysis Date
Lead	0.014	0.015		mg/l	SM3113B	MN	9/6/2016

Qualifiers Key:

X Exceeds maximum contamination limit	R Duplication outside acceptance limits	H Hold time exceeded
T Temperature outside specifications	A Sample contained air bubble or headspace	B Analyte detected in blank
P Sample preserved at lab	Z Analysis is not state-certified	C Incorrect bottle received
S(+/-) Lab control sample outside acceptance limits	M(+/-) Matrix spike recovery outside acceptance limits	
(+ Result may be biased high / - Result may be biased low)		

Legend: < Less Than, > Greater Than

mg/L=PPM, ug/L=PPB


If no collection time was given, 00:00 is reported

MCL = Maximum Contaminant Level referenced from New York State Subpart 5-1 of the Public Drinking Water Standards and/or National Primary/Secondary Drinking Water Standards.

Note 1: Per ELAP requirements, water analyzed for alkalinity, color, conductivity, nitrate, nitrite, sulfate, organics, UV absorbance, non-potable bacteriological analyses, BOD/CBOD, solids and phosphorus are required to be on ice to indicate the chilling process has begun. Samples must be between 0-6C and not frozen.

Comments:

Test procedures for all analyses meet NELAC requirements.



John Wilson
 Environmental Laboratory Supervisor and contact person
 If you have questions, please call.
 (518) 525-5480/5479

Reviewed by Brian Collins

These results relate to samples as received.