CASTALDI ANALYSIS REPORT
WAKULLA SENIOR HIGH
AUGUST 2016



CLEMONS, RUTHERFORD & ASSOCIATES, INC.

▪

ARCHITECTS
PLANNERS
INTERIOR DESIGNERS
CONSTRUCTION MANAGERS

▪

2027 Thomasville Road
Tallahassee, Florida 32308

▪

p:850-385-6153
f:850-386-8420
www.craarchitects.com

August 1, 2016

Robert Pearce
Superintendent
Wakulla County Schools
69 Arran Road
P.O. Box 100
Crawfordville, FL 32326

RE: Wakulla Senior High – Castaldi Report

Dear Superintendent Pearce:

At your request an inspection was made of the buildings 1, 4, 5, 6, 8 and 9 on the campus of Wakulla Senior High on April 19, 2016. Dr. John Watson was accompanied by Randy Bristol on the inspection.

Wakulla Senior High is located at 3237 Coastal Highway in Crawfordville. Parcel 4 is 56 acres in size and houses 17 permanent and six relocatable buildings. Water is provided by a public service and sewage is disposed of by an on-site plant. Drainage is adequate and parking is partially developed. For the purpose of this report buildings 1, 4, 5, 6, 8 and 9 were inspected and photographed. All of the buildings are presently reported as 'satisfactory' in FISH.

Cost per square foot values used in the Castaldi Formula were: New Construction $162; Remodeling $81; and Renovation $54 as required and supplied by DOE.

Building and Castaldi Report Findings

Building 1 – (104,468 sq ft – 15,283 sq ft of covered walkway = 89,185 sq ft) was constructed in 1966. Building 1 houses Administrative Offices, Senior High Classrooms, ESE Classrooms, JROTC, Art, Gymnasium, Auditorium and is the main reception area for all visitors. The mechanical systems need replacing and the electrical systems need upgrading. The plumbing sanitation pipes have deteriorated and also need replacing. Administrative spaces are undersized and the telecommunication and fire alarm systems needs to be upgraded. The roof is at the end of its life cycle and will require maintenance or replacement in the near future.

	Rem/Ren/Add	New	Prototype Percent
Estimate	$4,815,990	$14,447,970	33.33
Castaldi Formula			
	($4,815,990 X	1.2)	$14,447,970
	(65 - 50)	0.75 >	65
		$513,706 >	$222,277

Minimum Cost for Castaldi to Work: $2,083,842

Building 4 – (1,265 sq ft) was constructed in 1968. Building 4 houses Public Use Male and Female Restrooms, Gymnasium Storage and a Principal/Director Office. The mechanical systems need replacing and the electrical systems need upgrading. The plumbing sanitation pipes have deteriorated and also need replacing. There is no Heat or Air Conditioning provided to any spaces in the building.

	Rem/Ren/Add	New	Prototype Percent
Estimate	$68,310	$204,930	33.33
Castaldi Formula			
	($68,310 X	1.2)	$204,930
	(65 - 48)	0.75	> 65
		$6,430	> $3,153

Minimum Cost for Castaldi to Work: **$33,498**

Building 5 – (3,589 sq ft – 143 sp ft of covered walkway = 3,446 sq ft) was constructed in 1973. Building 5 houses Senior High Classrooms. The mechanical systems need replacing and the electrical systems need upgrading. The plumbing sanitation pipes have deteriorated and also need replacing.

	Rem/Ren/Add	New	Prototype Percent
Estimate	$186,084	$558,252	33.33
Castaldi Formula			
	($186,084 X	1.2)	$558,252
	(65 - 43)	0.75	65
		$13,533	> $8,588

Minimum Cost for Castaldi to Work: **$118,092**

Building 6 – (17,823 sq ft – 0 sp ft of covered walkway = 17,823 sq ft) was constructed in 1973. Building 6 houses a Band Classroom, Music Related Spaces, PE Weight Room, VPI Lab and Senior High Classrooms. The mechanical systems need replacing and the electrical systems need upgrading. The plumbing sanitation pipes have deteriorated and also need replacing.

	Rem/Ren/Add	New	Prototype Percent
Estimate	$962,442	$2,887,326	33.33
Castaldi Formula			
	($962,442 X	1.2)	$2,887,327
	(65 - 43)	0.75	> 65
		$69,996	> $44,420

Minimum Cost for Castaldi to Work: $610,781

Building 8 – (750 sq ft – 150 sp ft of covered walkway = 600 sq ft) was constructed in 1976. Building 8 houses a Male Staff Restroom and a Female Student Restroom. The mechanical systems need replacing and the electrical systems need upgrading. The plumbing sanitation pipes have deteriorated and also need replacing. There is no Heating or Air Conditioning supplied to any spaces.

	Rem/Ren/Add	New	Prototype Percent
Estimate	$32,400	$97,200	33.33
Castaldi Formula			
	($32,400 X	1.2)	$97,200
	(65 - 40)	0.75	65
		$2,074 >	$1,495

Minimum Cost for Castaldi to Work: **$23,365**

Building 9 – (4,568 sq ft – 1,560 sp ft of covered walkway = 3,008 sq ft)) was constructed in 1976. It houses a Medium Industrial Lab and Related Classroom. The mechanical systems need replacing and the electrical systems need upgrading. The plumbing sanitation pipes have deteriorated and also need replacing. There are fire safety concerns in the building due to the use of combustible construction materials.

	Rem/Ren/Add	New	Prototype Percent
Estimate	$162,432	$487,296	33.33
Castaldi Formula			
	($162,432 X	1.2)	$487,296
	(65 - 40)	0.75	> 65
		$10,396	> $7,496
Minimum Cost for Castaldi to Work:		**$117,138**	

From the results of the Castaldi Analysis and this inspection, we find the replacement of Buildings 1, 4, 5, 6, 8 and 9 is recommended.

It is also recommended that the replacement of these buildings be entered into your Facility Plant Survey as an amendment once this report is approved by your Board and the Office of Educational Facilities.

Sincerely,



Gregory W. Kelley, AIA
Architect
Clemons, Rutherford & Associates, Inc.

OFFICE OF EDUCATIONAL FACILITIES

FLORIDA DEPARTMENT OF EDUCATION

BUILDING REPLACEMENT/RAZE

OEF FORM RCC-BRR

Office of Educational Facilities
Florida Department of Education

Room Condition Change
Building Replacement/Raze

District/Community College Wakulla County Public Schools

Facility/Campus Name Wakulla Senior High

Building Number(s) 1, 4, 5, 6, 8 and 9

Contact Person Randy Bristol

Phone 850-926-0065

Facility Number (school districts only) 4

Parcel/Site Number(s) 4

This Proposed Project will:

- ☐ Change the condition of permanent rooms from satisfactory to unsatisfactory (if yes, go to Section I and complete certification in Section III). (Not applicable to community colleges)
- ☐ Change the condition of permanent rooms from unsatisfactory to satisfactory (if yes, go to Section I and complete certification in Section III). (Not applicable to community colleges)
- X Raze permanent building(s) (if yes, go to Section II and complete certification in Section III).
- X Replace permanent building(s) (if yes, go to Section II and complete certification in Section III).
  Major Capital Outlay Funding Source(s) – Original Building _____
  Major Capital Outlay Funding Source(s) – Replacement Building _____

This form is not required for razing a single, freestanding structure that is less than 750 NSF and is debt free, or multiple small structures on a single campus whose total area is less than 750 NSF and are debt free. This form must be completed for any structure 750 NSF or greater and any structure, regardless of size, that is not debt free.

A. DISTRICT/COMMUNITY COLLEGE CERTIFICATION

The district/community college must submit this certification document, completed and signed by the appropriate school officials, along with all required or necessary supporting documentation pertaining to the proposed project.

The Wakulla County District School Board/Community College Board hereby certifies that:

I. CONDITION CHANGE: (Not applicable to community colleges)

1. All room condition changes are consistent with State Requirements for Educational Facilities (SREF) standards and the Florida Fire Prevention Code (FFPC) requirements for the condition of space.

II. RAZE/REPLACE PERMANENT BUILDING(S):

1. All fund sources have been researched and no current indebtedness or outstanding debt exists for the building(s) that will be razed and/or replaced.
2. Funding Source(s):
   a. Original Building: _____

b. If Replaced: _____

3. Voters of the district have approved local bonding for the project: Yes/No
   a. Date of voter approval: _____
4. Imminent danger exists for the building(s) that will be razed and/or replaced.

III. CERTIFICATION SIGNATURES:

_____ _____

Director of Facilities Planning Date

_____ _____

Superintendent/President Date

_____ _____

Board Chair Date

NOTE: Certification is required by the Superintendent and Director of Facilities Planning for room condition changes. Certification is required by the Superintendent/President and Board Chair to raze or replace permanent buildings.

Submit signed form and supporting documents to:
Office of Educational Facilities, Room 1054
Florida Department of Education
325 West Gaines Street
Tallahassee, Florida 32399-0400

WAKULLA COUNTY SCHOOL BOARD

CASTALDI ANALYSIS - WAKULLA SENIOR HIGH SCHOOL

RAZE AND REPLACEMENT OF BUILDINGS 1, 4, 5, 6, 8 and 9

RATIONALE:

I. Detailed explanation of need for the proposed project and the expected benefit to the district/community college.

The proposed project is to raze and replace buildings 1, 4, 5, 6, 8, and 9 on the campus of Wakulla Senior High School located at 3237 Coastal Highway, Crawfordville, Florida. All buildings are presently occupied with students in grades 09-12. The enrollment for school year ending 2015/2016 was 1,416 students. The present capacity for Wakulla Senior High is 1,454 students.

Parcel 4 is 56 acres. Parking on Parcel 4 is partially developed. Water is supplied by a public system and sewage is disposed by an on-site plant. Parcel 4 contains 17 permanent and six portable buildings. The permanent buildings contain 1,381 student stations and the portable buildings contain 150 student stations. The capacity of all satisfactory buildings is 1,454 students.

Building 1 is 50; Building 4 is 48; Building 5 is 43; Building 6 is 43; and Buildings 8 and 9 are 40 years old. All buildings are concrete/brick construction. There is a central fire alarm system but it is outdated and is at full capacity causing false alarms. There is no central fire sprinkler system. Heating and cooling systems in all buildings are at the end of their life cycle and causing indoor air quality issues. It is also costly to operate and maintain these systems. There is inadequate infrastructure regarding electric and data to support current technology and testing requirements. Buildings are poorly insulated and some windows are original and in very poor condition. Water piping is galvanized under the slab and has continuous leaks requiring the slab to be removed. Door hardware throughout the school needs replacing. The roof on Building One is at the end of its life cycle and requires constant patching. There are safety concerns with the current campus layout including no separation of buses from student/parent traffic. It is the intent of the District to raze and replace Buildings 1, 4, 5, 6, 8 and 9. The cost of design and construction would be a combination of state and local funding. The replacement of these outdated buildings would provide a better learning environment for the students and faculty and would reduce the yearly school plant operations and maintenance cost.

ii. General scope of the proposed project.

The scope of the proposed project would be to raze and replace Buildings 1, 4, 5, 6, 8 and 9. It is the wishes of the Board to remain on the existing site. Wakulla Senior High School is the only high school in Wakulla County. The site also contains the District athletic facilities (football stadium, softball field, baseball field, soccer field, and field house), but they are not included as part of this report. The project would include demolition of Buildings 1, 4, 5, 6, 8 and 9 and correcting site drainage issues before constructing new buildings and new roadways and parking.

iii. Building age and year of construction.

Parcel 4:

Building 1 was constructed in 1966. Construction material is block/brick. The roof is flat. Lighting is shielded florescent. Electric service to all spaces is inadequate and in some cases in violation of existing code. Plumbing is cast iron throughout the building and in poor condition. Heating and air conditioning is poor and provided in all occupied spaces via central ducts. Heat source is central hot air. The total net square feet of the building, not including covered walkways, is 89,185 NSF. Building 1 houses Administrative Offices, Senior High Classrooms, ESE Classrooms, JROTC, Art, Gymnasium, Culinary Arts and Auditorium.

Building 4 was constructed in 1968. Construction material is concrete. The roof is flat and lighting is unshielded florescent. Electric service to all spaces is inadequate and in some cases in violation of existing code. Plumbing is cast iron throughout the building and in poor condition. Cooling is not provided. No heat is provided . The total net square feet of the building, not including covered walkways, is 1,265 NSF. Building 4 houses Public Male and Female Restrooms, Administrative Office and Gymnasium Storage.

Building 5 was constructed in 1973. Construction material is brick/concrete. The roof is metal and lighting is shielded florescent. Electric service to all spaces is inadequate and in some cases in violation of existing code. Plumbing is cast iron throughout the building and in poor condition. Heating is poor and provided in all occupied spaces via central ducts. Cooling is adequate and is provided by central system ducts. The total net square feet of the building, not including covered walkways, is 3,446 NSF. Building 5 houses Senior High Classrooms and Male and Female Student Restrooms.

Building 6 was constructed in 1973. Construction material is brick/concrete. The roof is metal and lighting is shielded florescent. Electric service to all spaces is inadequate and in some cases in violation of existing code. Plumbing is cast iron throughout the building and in poor condition. Heating is poor and provided in all occupied spaces via central ducts. Cooling is adequate and is provided by central system ducts. The total net square feet of the building, not including covered walkways, is 17,823 NSF. Building 6 houses the Band Classroom, PE Weight Room, Senior High Classrooms and Vocational VPI Lab.

Building 8 was constructed in 1976. Construction material is concrete. The roof is flat and lighting is indirect. Electric service to all spaces is inadequate and in some cases in violation of existing code. Plumbing is cast iron throughout the building and in poor condition. Heating is not provided. Cooling is not provided. The total net square feet of the building, not including covered walkways, is 600 NSF. Building 8 houses Male and Female Student Restrooms.

Building 9 was constructed in 1976. Construction material is brick. The roof is metal and lighting is shielded florescent. Electric service to all spaces is inadequate and in some cases in violation of existing code. Plumbing is cast iron throughout the building and in poor condition. Cooling is adequate and local zone. Heating source is Electric Zoned Hot Air. The total net square feet of the building, not including covered walkways, is 3,008 NSF. Building 9 houses a Medium Industrial Lab.

iv. Existing capacity of building(s), include the number of student stations, classrooms, and other instructional spaces.

Parcel 4:

Bldg 1 - Administrative Offices, Senior High Classrooms, ESE Classrooms, JROTC Classrooms, Art Classrooms, Senior High Gymnasium, Auditorium. Student Stations = 619. Total NSF (not including covered walkways) = 89,185.

Bldg 4 - Male and Female Public Restrooms, Administrative Office, Gymnasium Storage. Student Stations = 0. Total NSF (not including covered walkways) = 1,265.

Bldg 5 - Senior High Classrooms. Student Stations = 75. Total NSF (not including covered walkways) = 3,446.

Bldg 6 - Band Classroom, PE Weight Room, VPI Lab, Senior High Classrooms. Student Stations = 125. Total NSF (not including covered walkways) = 17,823.

Bldg 8 - One Senior High Vocal Music Classroom, One Senior High Band Classroom and One Auditorium. Student Stations = 75. Total NSF (not including covered walkways) = 13,324.

Bldg 9 - Medium Industrial Lab. Student Stations = 17. Total NSF (not including covered walkways) = 3,008.

Bldg 10 - Other PE Space. Student Stations = 0. Total NSF (not including covered walkways) = 1,212.

Bldg 11 - Other PE Space. Student Station = 0. Total NSF (not including covered walkways) = 474.

Bldg 13 - Concessions. Student Station = 0. Total NSF (not including covered walkways) = 423.

Bldg 14 - Concessions. Student Stations = 0. Total NSF (not including covered walkways) = 161.

Bldg 21 - Custodial Work Area and Flammable Storage. Student Stations = 0. Total NSF (not including covered walkways) = 698.

Bldg 22 - Custodial Equipment Storage. Student Stations = 0. Total NSF (not including covered walkways) = 600.

Bldg 26 - Full Service Clinic. Student Station = 0. Total NSF (not including covered walkways) = 4,255.

Bldg 27 - Media Center, Senior High Classrooms, Dining Area, Kitchen. Student Station = 525. Total NSF (not including covered walkways) = 72,567.

Bldg 28 - Student Male and Female Locker Rooms, Public Use Male and Female Restrooms. Student Station = 0. Total NSF (not including covered walkways) = 1,160.

Bldg 29 - Concessions, Male and Female Public Use Restrooms, PE Training Room, PE Locker Rooms. Student Station = 0. Total NSF (not including covered walkways) = 6,757.

Bldg 30 - Medium Industrial Lab. Student Station = 20. Total NSF (not including covered walkways) = 3,540.

Bldg 99 - Senior High Classrooms. Student Station = 150. Total NSF (not including covered walkways) = 4,986.

v. Current number of students housed and the projected number of students to be housed in the affected building(s).

Parcel 4:

	Students Housed	Students Projected
Bldg # 1 -	619	619
Bldg # 4 -	0	0
Bldg # 5 -	75	75
Bldg # 6 -	125	125
Bldg # 8 -	0	0
Bldg # 9 -	17	17

vi. Current educational plant survey recommendations and capacity.

The present survey has no recommendations in place at this time for Wakulla Senior High School. If this project is approved there will be a spot survey done to raze and replace the affected buildings.

vii. What alternatives have been considered besides razing/replacement and why are the alternatives not feasible?

It was determined not to be sound economics to again renovate the buildings because of their failing infrastructure.

viii. School board/community college board approval of the concept of razing/replacing permanent buildings.

The Wakulla County School Board approved the project in an official Board meeting on August 15, 2016.

ix. Building condition/engineer study (optional).

No condition/engineering study has been conducted. Due to the advanced age of the buildings, it was considered a waste of funds to conduct such a study.

x. Impact of the proposed project is not approved.

Students and staff would continue to occupy structures that have exceeded their life expectancy and the Board would continue to spends large sums for operation and maintenance,

xi. Other relevant data; identify any major systems (include data, if applicable) that have been replaced or upgraded, e.g. electrical, HVAC, fire alarm, roof, plumbing, drainage, etc. Provide a general scope of work for any previous remodeling, renovation, and addition, and year completed.

2015 Guidance Office Addition
2014 Gym Floor and Bleachers
2013 Guidance Office Renovation
2009 Re-Roofing
2005 Windows/Doors/Locks/Grilles
2005 HVAC Control Upgrade/Retrofit
2001 Small Engine Room Renovation
2001 Physical Education Renovation
2000 Re-Roofing
1999 Covered Walkway Replacement
1999 Gum and Auditorium Renovation
1997 Locker Room Building
1996 Covered Walkways
1994 Auditorium HVAC Renovation
1994 Science and Technology Lab
1994 Retrofit for Technology - Network
1993 Classroom Improvements
1992 Remodeling of Science Labs
1989 Cafeteria & Girls Locker Room Renovation

COST ANALYSIS

I. Castaldi Analysis (or other cost analysis formula to support the proposed project). (See Attached Castaldi Report)

ii. The following five questions must be addressed:

1. How many years will modernization extend the useful life of the modernized building(s)?

Due to the advanced age and condition of the buildings modernization costs far exceed the cost of replacing the existing structures. Modernization was never considered as a viable financial option.

2. Does the existing building(s) lend itself to improvement, alteration, remodeling, and expansion? If not, explain why not.

Due to the advanced age and condition of the buildings modernization costs far exceed the cost of replacing the existing structures.

3. Explain how a modernized and a replacement building(s) fit into a well conceived long range plan of the district/community college?

The replacement building(s) will enable the district to continue to provide educational services to those children residing in the county. There are no other high schools in the area.

4. What is the percentage derived by dividing the cost of modernization by the cost for a replacement building?

Due to the advanced age and condition of the buildings modernization costs far exceed the cost of replacing the existing structures. Modernization was never considered as a viable financial option.

5. A committee of district officials and independent citizens from outside the school attendance zone has determined that the replacement of the building(s) is financially justified and no other alternative is feasible? (Not applicable to community colleges).

The School Facilities Improvement Group made up of parents, teachers, local business owners, members of community at large and school board administrators approved the replacement of this facility in August 2016.

iii. Detailed scope of work for modernization of existing building(s).

Due to the advanced age and condition of the buildings modernization costs far exceed the cost of replacing the existing structures.

iv. FISH building plan and/or schematic drawings of the existing building with FISH room numbers.

See plans.

CASTALDI REPORT FORMS

WAKULLA SENIOR SCHOOL

BUILDINGS 1, 4, 5, 6, 8 AND 9.
PARCEL 4

WAKULLA SENIOR HIGH SCHOOL
PARCEL #4

BUILDING NUMBER	1		
Building area	89185	**Survey recommends new building.**	
Present year	2016		
Year building built	1966		
Age of structure	50	Area added/remodeled/renovated	
Cost new construction	$162.00	0	$0.00
Cost Remodeling	$81.00	0	$0.00
Cost Renovation	$54.00	89185	$4,815,990.00
		89185 totals	$4,815,990.00

	Rem/Ren/Add	New	Percent Prototype
Estimate	$4,815,990	$14,447,970	33.33

Castaldi Formula

$$\frac{\$4{,}815{,}990 \times 1.2}{(65 - 50) \times 0.75} > \frac{\$14{,}447{,}970}{65}$$

$$\$513{,}705.60 > \$222{,}276.46$$

Minimum Cost for Calstaldi to work $2,083,842

BUILDING NUMBER	4		
Building area	1265	**Survey recommends new building.**	
Present year	2016		
Year building built	1968		
Age of structure	48	Area added/remodeled/renovated	
Cost new construction	$162.00	0	$0.00
Cost Remodeling	$81.00	0	$0.00
Cost Renovation	$54.00	1265	$68,310.00
		1265 totals	$68,310.00

	Rem/Ren/Add	New	Percent Prototype
Estimate	$68,310	$204,930	33.33

Castaldi Formula

$$\frac{\$68{,}310 \times 1.2}{(65 - 48) \times 0.75} > \frac{\$204{,}930}{65}$$

$$\$6{,}429.18 > \$3{,}152.77$$

Minimum Cost for Calstaldi to work $33,498

WAKULLA SENIOR HIGH SCHOOL
PARCEL #4

BUILDING NUMBER	5		
Building area	3446		
Present year	2016		
Year building built	1973		
Age of structure	43	Area added/remodeled/renovated	
Cost new construction	$162.00	0	
Cost Remodeling	$81.00	0	$0.00
Cost Renovation	$54.00	3446	$186,084.00
		3446 totals	$186,084.00

	Rem/Ren/Add	New	Percent Prototype
Estimate	$186,084	$558,252	33.33

Castaldi Formula

$$\frac{\$186{,}084 \times 1.2}{(65 - 43) \times 0.75} > \frac{\$558{,}252}{65}$$

$$\$13{,}533.38 > \$8{,}588.49$$

Minimum Cost for Calstaldi to work $118,092

BUILDING NUMBER	6		
Building area	17823		
Present year	2016		
Year building built	1973		
Age of structure	43	Area added/remodeled/renovated	
Cost new construction	$162.00	0	
Cost Remodeling	$81.00	0	$0.00
Cost Renovation	$54.00	17823	$962,442.00
		17823 totals	$962,442.00

	Rem/Ren/Add	New	Percent Prototype
Estimate	$962,442	$2,887,326	33.33

Castaldi Formula

$$\frac{\$962{,}442 \times 1.2}{(65 - 43) \times 0.75} > \frac{\$2{,}887{,}326}{65}$$

$$\$69{,}995.78 > \$44{,}420.40$$

Minimum Cost for Calstaldi to work $610,781

WAKULLA SENIOR HIGH SCHOOL
PARCEL #4

BUILDING NUMBER	8		
Building area	600		
Present year	2016		
Year building built	1976		
Age of structure	40	Area added/remodeled/renovated	
Cost new construction	$162.00	0	$0.00
Cost Remodeling	$81.00	0	$0.00
Cost Renovation	$54.00	600	$32,400.00
		600 totals	$32,400.00

	Rem/Ren/Add	New	Percent Prototype
Estimate	$32,400	$97,200	33.33

Castaldi Formula

	$32,400		x	1.2		$97,200
	----------	----------	----------	----------	>	----------
(	65	-	40	)	0.75	65
					$2,073.60 >	$1,495.38

Minimum Cost for Calstaldi to work $23,365

BUILDING NUMBER	9		
Building area	3008	**Survey recommends new building.**	
Present year	2016		
Year building built	1976		
Age of structure	40	Area added/remodeled/renovated	
Cost new construction	$162.00	0	$0.00
Cost Remodeling	$81.00	0	$0.00
Cost Renovation	$54.00	3008	$162,432.00
		3008 totals	$162,432.00

	Rem/Ren/Add	New	Percent Prototype
Estimate	$162,432	$487,296	33.33

Castaldi Formula

	$162,432		x	1.2		$487,296
	----------	----------	----------	----------	>	----------
(	65	-	40	)	0.75	65
					$10,395.65 >	$7,496.86

Minimum Cost for Calstaldi to work $117,138

WAKULLA SENIOR HIGH SCHOOL

FISH REPORT

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

ORGANIZATION: 65-WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: WAKULLA SENIOR HIGH

FACILITY USE: 7-SENIOR HIGH

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

Primary Use: SENIOR HIGH Grades Housed: 09 - 12 DOE Validation Date: Capital Outlay Classification: SCHOOL RECOMMENDED FOR CONTINUED USE

MASTER SCHOOL ID

MSID	Name	Status
71	WAKULLA HIGH SCHOOL	Default

CAPITAL OUTLAY FTE

Year: 2014 / 2015							
PK: 0.00	01: 0.00	03: 0.00	05: 0.00	07: 0.00	09: 412.59	11: 318.32	PK-12: 1334.18
KG: 0.00	02: 0.00	04: 0.00	06: 0.00	08: 0.00	10: 355.90	12: 247.37	Adult: 0.00
							Total: 1334.18

SCHOOL CAPACITY

SCHOOL CAPACITY	YEAR ROUND CAPACITY	UTILIZATION FACTOR	PRIMARY USE
1,454	1,745	0.95	SENIOR HIGH

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

PARCEL: 4

3237 COASTAL HIGHWAY

CRAWFORDVILLE, FL 32327

Parking: DEVELOPED	Owner: SCHOOL BOARD	Fire: 9
Athletic: INCLUDED WITH SITE	Water: PUBLIC	Police: COUNTY
Sewage: ON-SITE PLANT	Plan: COMBINATION OF 1-7	Drainage: ADEQUATE
Landscape: PARTIALLY DEVELOPED	Playground: INCLUDED WITH SITE	Acreage: 56.21
Date Acquired: 1/1/1966		Lease Expiration Date:

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 1 - Building Number 00001

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: CENTRAL
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: OIL
Year Constructed: 1966	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: CENTRAL HOT AIR
Year Modified:	Educational TV: NONE	Heat Capacity: ADEQUATE
Average Age NSF: 1968	Intercom: TWO WAY COMPLETE	Walls: BRICK
Relocatable Units: 0	Telephone: COMPLETE TO ALL ROOMS	Struct Comp: COMBINATION OF 1-3
Stories: 1		Corridor: DOUBLE INSIDE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	1040	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
001A	432	315	TEACHER PLANNING OFFICE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
002	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

003	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
004	616	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
005	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
006	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
006A	293	330	CUSTODIAL RECEIVING	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
006B	183	334	CUSTODIAL EQUIPMENT STORAGE	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
007	687	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
008	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
009	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
011	372	304	RECEPTION AREA	0	01	CARPET	1966	SATISFACTORY	1	4	4
011A	118	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
011B	120	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
011C	98	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
011D	104	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
011E	98	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
011F	46	702	MECHANICAL ROOM	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
011G	52	808	MATERIAL STORAGE	0	01	CARPET	1966	SATISFACTORY	1	4	4
011H	36	306	CONFERENCE ROOM	0	01	CARPET	1966	SATISFACTORY	1	4	4
011J	146	821	STAFF RESTROOM (BOTH SEXES)	0	01	CARPET	1966	SATISFACTORY	1	4	4
011K	151	700	INSIDE CIRCULATION	0	01	CARPET	1966	SATISFACTORY	1	4	4
012	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
012A	297	819	STAFF RESTROOM (MALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
012B	297	816	STUDENT RESTROOM (FEMALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
013	689	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

014	689	312	COMPUTER AREA	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
015	465	40	RESOURCE ROOM	0	01	CARPET	1966	SATISFACTORY	1	4	4
015A	38	317	GENERAL SCHOOL SPACE	0	01	CARPET	1966	SATISFACTORY	1	4	4
015B	80	317	GENERAL SCHOOL SPACE	0	01	CARPET	1966	SATISFACTORY	1	4	4
020	689	317	GENERAL SCHOOL SPACE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
021	689	22	SENIOR HIGH SCIENCE DEMO (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
022	689	22	SENIOR HIGH SCIENCE DEMO (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
022A	139	808	MATERIAL STORAGE	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
023	1298	23	SENIOR HIGH SCIENCE LAB (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
023A	386	315	TEACHER PLANNING OFFICE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
023B	183	808	MATERIAL STORAGE	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
024	792	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
024A	916	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
024B	183	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
025	715	61	E S E PART-TIME	15	01	CARPET	1966	SATISFACTORY	1	4	4
025A	487	315	TEACHER PLANNING OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
025B	16	702	MECHANICAL ROOM	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
025C	76	814	STUDENT RESTROOM (BOTH SEXES)	0	01	CERAMIC TILE	1966	SATISFACTORY	1	4	4
026	715	62	E S E FULL-TIME	10	01	CARPET	1966	SATISFACTORY	1	4	4
027	773	61	E S E PART-TIME	15	01	CARPET	1966	SATISFACTORY	1	4	4
028	611	62	E S E FULL-TIME	10	01	CARPET	1966	SATISFACTORY	1	4	4
029	710	61	E S E PART-TIME	15	01	CARPET	1966	SATISFACTORY	1	4	4
029A	170	315	TEACHER PLANNING OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
029B	54	68	E S E TIME-OUT ROOM	0	01	CARPET	1966	SATISFACTORY	1	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

030	260	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
030A	105	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
030B	94	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
030C	172	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
030D	31	305	PRODUCTION WORKROOM	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
030E	197	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
030F	174	306	CONFERENCE ROOM	0	01	CARPET	1966	SATISFACTORY	1	4	4
030G	177	309	VAULT/STUDENT RECORDS	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
030H	45	702	MECHANICAL ROOM	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
030J	132	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
030K	106	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	2013	SATISFACTORY	1	4	4
030N	95	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	2016	SATISFACTORY	1	4	4
030P	95	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	2016	SATISFACTORY	1	4	4
031	846	313	CAREERS ROOM	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
031A	253	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	2013	SATISFACTORY	1	4	4
031B	145	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	2013	SATISFACTORY	1	4	4
031C	160	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	2013	SATISFACTORY	1	4	4
032	689	212	BUSINESS EDUCATION LAB	10	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
032A	506	40	RESOURCE ROOM	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
033	689	708	JROTC	16	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
033A	337	315	TEACHER PLANNING OFFICE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
034	867	52	ART - SENIOR HIGH	16	01	TERRAZZO	1966	SATISFACTORY	1	4	4
034A	100	315	TEACHER PLANNING OFFICE	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
034B	21	808	MATERIAL STORAGE	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

034C	42	808	MATERIAL STORAGE	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
035	1777	52	ART - SENIOR HIGH	30	01	CONCRETE	1966	SATISFACTORY	1	4	4
035A	99	317	GENERAL SCHOOL SPACE	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
035B	119	808	MATERIAL STORAGE	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
035C	118	812	PROJECT STORAGE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
035D	192	700	INSIDE CIRCULATION	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
035E	100	805	KILN	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
036	700	810	MATERIAL STORAGE (LARGE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
037	1628	801	FIRING RANGE (INDOOR)	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
039	428	304	RECEPTION AREA	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
039A	116	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
039B	116	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
039C	153	309	VAULT/STUDENT RECORDS	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
040	732	385	CLOSED CIRCUIT TV LAB	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
040A	87	315	TEACHER PLANNING OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
040B	127	702	MECHANICAL ROOM	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
050	1022	93	P E LOCKER ROOM (FEMALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
050A	62	820	STAFF RESTROOM (FEMALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
050B	96	114	P E LAUNDRY	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
050C	151	816	STUDENT RESTROOM (FEMALE)	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
050D	191	95	P E SHOWER (FEMALE)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
050E	157	93	P E LOCKER ROOM (FEMALE)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
050F	209	315	TEACHER PLANNING OFFICE	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
051	71	702	MECHANICAL ROOM	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

052	1560	110	P E MULTIPURPOSE ROOM (MIDDLE-SR HIGH)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
053	71	702	MECHANICAL ROOM	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
054	1242	92	P E LOCKER ROOM (MALE)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
054A	60	819	STAFF RESTROOM (MALE)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
054B	93	114	P E LAUNDRY	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
054C	151	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	1966	SATISFACTORY	1	4	4
054D	191	94	P E SHOWER (MALE)	0	01	CERAMIC TILE	1966	SATISFACTORY	1	4	4
054E	170	92	P E LOCKER ROOM (MALE)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
054F	209	315	TEACHER PLANNING OFFICE	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
054G	528	98	P E STORAGE (MIDDLE-SR HIGH)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
054H	396	702	MECHANICAL ROOM	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
055	11770	112	SR HIGH GYMNASIUM	70	01	WOOD	1966	SATISFACTORY	1	4	4
055A	160	816	STUDENT RESTROOM (FEMALE)	0	01	CERAMIC TILE	1966	SATISFACTORY	1	4	4
055B	160	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	1966	SATISFACTORY	1	4	4
055C	888	304	RECEPTION AREA	0	01	CARPET	1966	SATISFACTORY	1	4	4
055E	288	117	P E WEIGHT ROOM	0	01	CARPET	1966	SATISFACTORY	1	4	4
055F	186	310	SCHOOL STORE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
056	5278	360	AUDITORIUM	0	01	CARPET	1966	SATISFACTORY	1	4	4
056A	113	365	STAGE DRESSING ROOM (MALE)	0	01	CARPET	1966	SATISFACTORY	1	4	4
056B	1296	363	STAGE	0	01	WOOD	1966	SATISFACTORY	1	4	4
056C	113	366	STAGE DRESSING ROOM (FEMALE)	0	01	WOOD	1966	SATISFACTORY	1	4	4
056D	32	821	STAFF RESTROOM (BOTH SEXES)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
056E	32	815	STUDENT RESTROOM (MALE)	0	01	QUARRY TILE	1966	SATISFACTORY	1	4	4
056F	174	700	INSIDE CIRCULATION	0	01	CONCRETE	1966	SATISFACTORY	1	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

056G	174	700	INSIDE CIRCULATION	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
056H	94	367	CONTROL BOOTH/PROJECTION ROOM	0	01	CARPET	2011	SATISFACTORY	1	4	4
057	865	364	STAGE STORAGE	0	01	CARPET	1995	SATISFACTORY	1	4	4
058	633	52	ART - SENIOR HIGH	12	01	CARPET	1995	SATISFACTORY	1	4	4
058A	86	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	1	4	4
058B	60	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	1	4	4
058C	60	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	1	4	4
080	540	304	RECEPTION AREA	0	01	CARPET	1966	SATISFACTORY	1	4	4
080A	180	700	INSIDE CIRCULATION	0	01	CARPET	1966	SATISFACTORY	1	4	4
080B	130	700	INSIDE CIRCULATION	0	01	CARPET	1966	SATISFACTORY	1	4	4
081	240	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
082	269	300	PRINCIPAL/DIRECTOR OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
083	260	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
083A	46	822	PUBLIC USE RESTROOM (MALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
083B	59	308	GENERAL SCHOOL STORAGE	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
084	167	300	PRINCIPAL/DIRECTOR OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
085	167	300	PRINCIPAL/DIRECTOR OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
086	249	300	PRINCIPAL/DIRECTOR OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
086A	126	300	PRINCIPAL/DIRECTOR OFFICE	0	01	CARPET	1966	SATISFACTORY	1	4	4
087	561	316	TEACHER LOUNGE/DINING	0	01	CARPET	1966	SATISFACTORY	1	4	4
087A	57	822	PUBLIC USE RESTROOM (MALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
087B	57	823	PUBLIC USE RESTROOM (FEMALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
088	238	822	PUBLIC USE RESTROOM (MALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
089	265	823	PUBLIC USE RESTROOM (FEMALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

090	3817	340	DINING AREA	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
091	1166	346	KITCHEN FOOD PREPARATION	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
091A	56	822	PUBLIC USE RESTROOM (MALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
091B	56	823	PUBLIC USE RESTROOM (FEMALE)	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
091C	59	343	KITCHEN OFFICE	0	01	TERRAZZO	1966	SATISFACTORY	1	4	4
091D	240	342	KITCHEN DRY STORAGE	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
091E	72	350	OTHER FOOD SERVICE	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
091F	99	350	OTHER FOOD SERVICE	0	01	OTHER	1966	SATISFACTORY	1	4	4
091G	209	701	COVERED WALKWAY	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
092	225	331	CUSTODIAL SERVICE CLOSET	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
093	9759	701	COVERED WALKWAY	0	01	CONCRETE	1980	SATISFACTORY	1	4	4
094	14943	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1966	SATISFACTORY	1	4	4
095	658	702	MECHANICAL ROOM	0	01	CONCRETE	1966	SATISFACTORY	1	4	4
096	5315	701	COVERED WALKWAY	0	01	CONCRETE	1966	SATISFACTORY	1	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	104,468	619	0	0				
TOTAL	104,468	619	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 4 - Building Number 00004

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: NONE
Year Constructed: 1968	Artificial Lighting: UNSHIELDED INCANDESCENT	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1968	Intercom: NONE	Walls: CONCRETE
Relocatable Units: 0	Telephone: NONE	Struct Comp: CONCRETE
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
053A	200	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CONCRETE	1968	SATISFACTORY	4	4	4
053B	48	822	PUBLIC USE RESTROOM (MALE)	0	01	CONCRETE	1968	SATISFACTORY	4	4	4
053C	878	120	GYMNASIUM STORAGE	0	01	CONCRETE	1968	SATISFACTORY	4	4	4
053D	139	300	PRINCIPAL/DIRECTOR OFFICE	0	01	CARPET	1968	SATISFACTORY	4	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	1,265	0	0	0				
TOTAL	1,265	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 5 - CLASSROOMS

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: CENTRAL
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: ELECTRIC
Year Constructed: 1973	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: CENTRAL HOT AIR
Year Modified:	Educational TV: NONE	Heat Capacity: ADEQUATE
Average Age NSF: 1973	Intercom: TWO WAY COMPLETE	Walls: BRICK
Relocatable Units: 0	Telephone: NONE	Struct Comp: CONCRETE
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
201	968	3	SENIOR HIGH CLASSROOM (9-12)	25	01	COMPOSITION TILE	1973	SATISFACTORY	5	4	4
202	38	808	MATERIAL STORAGE	0	01	CARPET	1973	SATISFACTORY	5	4	4
203	62	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	1973	SATISFACTORY	5	4	4
204	62	816	STUDENT RESTROOM (FEMALE)	0	01	CERAMIC TILE	1973	SATISFACTORY	5	4	4
205	53	700	INSIDE CIRCULATION	0	01	CARPET	1973	SATISFACTORY	5	4	4
206	219	315	TEACHER PLANNING OFFICE	0	01	CARPET	1973	SATISFACTORY	5	4	4
207	43	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1973	SATISFACTORY	5	4	4
208	130	315	TEACHER PLANNING OFFICE	0	01	CARPET	1973	SATISFACTORY	5	4	4
209	1623	32	SENIOR HIGH OPEN PLAN (9-12)	50	01	CARPET	1973	SATISFACTORY	5	4	4
210	31	700	INSIDE CIRCULATION	0	01	CONCRETE	1973	SATISFACTORY	5	4	4
211	84	702	MECHANICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	5	4	4
212	63	702	MECHANICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	5	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

213	70	702	MECHANICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	5	4	4
214	143	701	COVERED WALKWAY	0	01	CONCRETE	1973	SATISFACTORY	5	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	3,589	75	0	0				
TOTAL	3,589	75	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 6 - Building Number 00006

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: CENTRAL
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: ELECTRIC
Year Constructed: 1973	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: CENTRAL HOT AIR
Year Modified:	Educational TV: NONE	Heat Capacity: INADEQUATE
Average Age NSF: 1973	Intercom: TWO WAY COMPLETE	Walls: BRICK
Relocatable Units: 0	Telephone: PARTIAL SYSTEM	Struct Comp: COMBINATION OF 1-3
Stories: 1		Corridor: DOUBLE INSIDE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
070	2057	76	BAND CLASS (MIDDLE-SR HIGH)	50	01	CARPET	1973	SATISFACTORY	6	4	4
070A	44	702	MECHANICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
070B	100	315	TEACHER PLANNING OFFICE	0	01	CARPET	1973	SATISFACTORY	6	4	4
070C	132	806	REFERENCE	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
070D	81	831	MUSIC PRACTICE ROOM	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
070E	9	83	MUSIC RELATED SPACE	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
070F	9	83	MUSIC RELATED SPACE	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
070G	9	83	MUSIC RELATED SPACE	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
070H	74	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
070J	100	831	MUSIC PRACTICE ROOM	0	01	CARPET	1973	SATISFACTORY	6	4	4
070K	100	831	MUSIC PRACTICE ROOM	0	01	CARPET	1973	SATISFACTORY	6	4	4
070L	100	831	MUSIC PRACTICE ROOM	0	01	CARPET	1973	SATISFACTORY	6	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

070M	108	808	MATERIAL STORAGE	0	01	CARPET	1973	SATISFACTORY	6	4	4
070N	72	700	INSIDE CIRCULATION	0	01	CARPET	1973	SATISFACTORY	6	4	4
070P	214	83	MUSIC RELATED SPACE	0	01	CARPET	1973	SATISFACTORY	6	4	4
071	407	315	TEACHER PLANNING OFFICE	0	01	CARPET	1973	SATISFACTORY	6	4	4
072	777	121	OTHER P E SPACE	0	01	CARPET	1973	SATISFACTORY	6	4	4
073	1864	117	P E WEIGHT ROOM	0	01	OTHER	1973	SATISFACTORY	6	4	4
073A	192	315	TEACHER PLANNING OFFICE	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
073B	231	90	P E DRESSING ROOM (MALE)	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
073C	40	703	ELECTRICAL ROOM	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
073D	100	98	P E STORAGE (MIDDLE-SR HIGH)	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
073E	64	808	MATERIAL STORAGE	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
073F	555	701	COVERED WALKWAY	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
073G	64	808	MATERIAL STORAGE	0	01	CARPET	1973	SATISFACTORY	6	4	4
073H	80	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
074	660	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
075	403	317	GENERAL SCHOOL SPACE	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
076	1053	271	VPI LAB	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
077	1009	272	VOCATIONAL LAB SUPPORT SPACE	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
078	403	317	GENERAL SCHOOL SPACE	0	01	CARPET	1973	SATISFACTORY	6	4	4
078C	147	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	1973	SATISFACTORY	6	4	4
078E	87	331	CUSTODIAL SERVICE CLOSET	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
078F	95	702	MECHANICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
079	1109	853	VOCATIONAL TESTING	0	01	CARPET	1973	SATISFACTORY	6	4	4
080	670	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1973	SATISFACTORY	6	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

080A	132	702	MECHANICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
080B	40	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4
081	599	40	RESOURCE ROOM	0	01	CARPET	1973	SATISFACTORY	6	4	4
082	617	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1973	SATISFACTORY	6	4	4
083	617	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1973	SATISFACTORY	6	4	4
084	583	317	GENERAL SCHOOL SPACE	0	01	CARPET	1973	SATISFACTORY	6	4	4
084A	280	315	TEACHER PLANNING OFFICE	0	01	CARPET	1973	SATISFACTORY	6	4	4
085	280	315	TEACHER PLANNING OFFICE	0	01	CARPET	1973	SATISFACTORY	6	4	4
085A	126	808	MATERIAL STORAGE	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
086	191	816	STUDENT RESTROOM (FEMALE)	0	01	CERAMIC TILE	1973	SATISFACTORY	6	4	4
087	137	702	MECHANICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
088	140	703	ELECTRICAL ROOM	0	01	CONCRETE	1973	SATISFACTORY	6	4	4
089	862	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1973	SATISFACTORY	6	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	17,823	125	0	0				
TOTAL	17,823	125	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 8 - Building Number 00008

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: NONE
Year Constructed: 1976	Artificial Lighting: INDIRECT LIGHTING	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1976	Intercom: NONE	Walls: CONCRETE
Relocatable Units: 0	Telephone: NONE	Struct Comp: CONCRETE
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	300	819	STAFF RESTROOM (MALE)	0	01	QUARRY TILE	1976	SATISFACTORY	8	4	4
002	300	816	STUDENT RESTROOM (FEMALE)	0	01	COMPOSITION TILE	1976	SATISFACTORY	8	4	4
003	150	701	COVERED WALKWAY	0	01	CONCRETE	1976	SATISFACTORY	8	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	750	0	0	0				
TOTAL	750	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 9 - Building Number 00009

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: LOCAL ZONE
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: ELECTRIC
Year Constructed: 1976	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: ZONE HOT AIR
Year Modified:	Educational TV: NONE	Heat Capacity: ADEQUATE
Average Age NSF: 1976	Intercom: TWO WAY COMPLETE	Walls: BRICK
Relocatable Units: 0	Telephone: NONE	Struct Comp: COMBINATION OF 1-3
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
079	1631	245	MEDIUM INDUSTRIAL LAB	17	01	CONCRETE	1976	SATISFACTORY	9	4	4
079A	502	840	VOCATIONAL RELATED CLASSROOM	0	01	COMPOSITION TILE	1976	SATISFACTORY	9	4	4
079B	193	808	MATERIAL STORAGE	0	01	CONCRETE	1976	SATISFACTORY	9	4	4
079C	200	810	MATERIAL STORAGE (LARGE)	0	01	CONCRETE	1976	SATISFACTORY	9	4	4
079D	60	808	MATERIAL STORAGE	0	01	CONCRETE	1976	SATISFACTORY	9	4	4
079E	101	315	TEACHER PLANNING OFFICE	0	01	COMPOSITION TILE	1976	SATISFACTORY	9	4	4
079F	205	272	VOCATIONAL LAB SUPPORT SPACE	0	01	CONCRETE	1976	SATISFACTORY	9	4	4
079G	116	700	INSIDE CIRCULATION	0	01	CONCRETE	1976	SATISFACTORY	9	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

079H	1560	701	COVERED WALKWAY	0	01	CONCRETE	1976	SATISFACTORY	9	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	4,568	17	0	0				
TOTAL	4,568	17	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 10 - Building Number 00010

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: NONE
Year Constructed: 1973	Artificial Lighting: UNSHIELDED INCANDESCENT	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1973	Intercom: NONE	Walls: WOOD
Relocatable Units: 0	Telephone: NONE	Struct Comp: WOOD
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	1212	121	OTHER P E SPACE	0	01	CONCRETE	1973	SATISFACTORY	10	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	1,212	0	0	0				
TOTAL	1,212	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 11 - Building Number 00011

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: NONE
Year Constructed: 1975	Artificial Lighting: UNSHIELDED INCANDESCENT	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1975	Intercom: NONE	Walls: WOOD
Relocatable Units: 0	Telephone: NONE	Struct Comp: WOOD
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	237	121	OTHER P E SPACE	0	01	CONCRETE	1975	SATISFACTORY	11	4	4
002	237	121	OTHER P E SPACE	0	01	CONCRETE	1975	SATISFACTORY	11	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	474	0	0	0				
TOTAL	474	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 13 - Building Number 00013

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: NONE
Year Constructed: 1972	Artificial Lighting: UNSHIELDED INCANDESCENT	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1972	Intercom: NONE	Walls: CONCRETE
Relocatable Units: 0	Telephone: NONE	Struct Comp: CONCRETE
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	423	371	CONCESSIONS	0	01	CONCRETE	1972	SATISFACTORY	13	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	423	0	0	0				
TOTAL	423	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 14 - Building Number 00014

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: NONE
Year Constructed: 1972	Artificial Lighting: UNSHIELDED INCANDESCENT	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1972	Intercom: NONE	Walls: WOOD
Relocatable Units: 0	Telephone: NONE	Struct Comp: WOOD
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	161	371	CONCESSIONS	0	01	CONCRETE	1972	SATISFACTORY	14	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	161	0	0	0				
TOTAL	161	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 21 - Building Number 00021

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: OTHER	Mech Vent: ADEQUATE	Heat Source: NONE
Year Constructed: 1991	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1991	Intercom: NONE	Walls: BRICK
Relocatable Units: 0	Telephone: NONE	Struct Comp: COMBINATION OF 1-3
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	543	332	CUSTODIAL WORK AREA	0	01	CONCRETE	1991	SATISFACTORY	21	4	4
002	155	333	FLAMMABLE STORAGE	0	01	CONCRETE	1991	SATISFACTORY	21	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	698	0	0	0				
TOTAL	698	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 22 - Building Number 00022

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: NONE
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: NONE
Year Constructed: 1991	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: NO HEAT PROVIDED
Year Modified:	Educational TV: NONE	Heat Capacity: NONE
Average Age NSF: 1991	Intercom: NONE	Walls: WOOD
Relocatable Units: 0	Telephone: NONE	Struct Comp: WOOD
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	600	334	CUSTODIAL EQUIPMENT STORAGE	0	01	WOOD	1991	SATISFACTORY	22	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	600	0	0	0				
TOTAL	600	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 26 - FULL SERVICE CLINIC

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: LOCAL ZONE
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: ELECTRIC
Year Constructed: 1994	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: ZONE HOT AIR
Year Modified:	Educational TV: COMMERCIAL CABLE	Heat Capacity: ADEQUATE
Average Age NSF: 1994	Intercom: TWO WAY COMPLETE	Walls: COMBINATION OF 1-5
Relocatable Units: 0	Telephone: COMPLETE TO ALL ROOMS	Struct Comp: CONCRETE
Stories: 1		Corridor: SINGLE INSIDE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
100	544	40	RESOURCE ROOM	0	01	CARPET	1994	SATISFACTORY	26	4	4
100A	50	817	STUDENT RESTROOM & BATH	0	01	COMPOSITION TILE	1994	SATISFACTORY	26	4	4
100B	100	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1994	SATISFACTORY	26	4	4
100C	50	864	VOCATIONAL ISOLATION ROOM	0	01	CERAMIC TILE	1994	SATISFACTORY	26	4	4
100D	83	842	KITCHEN (HOME ECONOMICS)	0	01	OTHER	1994	SATISFACTORY	26	4	4
101	544	40	RESOURCE ROOM	0	01	CARPET	1994	SATISFACTORY	26	4	4
101A	53	817	STUDENT RESTROOM & BATH	0	01	COMPOSITION TILE	1994	SATISFACTORY	26	4	4
101B	100	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1994	SATISFACTORY	26	4	4
101C	83	864	VOCATIONAL ISOLATION ROOM	0	01	CERAMIC TILE	1994	SATISFACTORY	26	4	4
102A	280	700	INSIDE CIRCULATION	0	01	CARPET	1994	SATISFACTORY	26	4	4
102B	73	700	INSIDE CIRCULATION	0	01	CARPET	1994	SATISFACTORY	26	4	4
102C	260	700	INSIDE CIRCULATION	0	01	CARPET	1994	SATISFACTORY	26	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

102D	56	700	INSIDE CIRCULATION	0	01	CARPET	1994	SATISFACTORY	26	4	4
103	115	304	RECEPTION AREA	0	01	CARPET	1994	SATISFACTORY	26	4	4
104	80	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1994	SATISFACTORY	26	4	4
105	66	308	GENERAL SCHOOL STORAGE	0	01	OTHER	1994	SATISFACTORY	26	4	4
106	108	307	CLINIC	0	01	OTHER	1994	SATISFACTORY	26	4	4
107	108	307	CLINIC	0	01	OTHER	1994	SATISFACTORY	26	4	4
108	108	307	CLINIC	0	01	OTHER	1994	SATISFACTORY	26	4	4
109	48	703	ELECTRICAL ROOM	0	01	CONCRETE	1994	SATISFACTORY	26	4	4
110	96	307	CLINIC	0	01	OTHER	1994	SATISFACTORY	26	4	4
111	138	307	CLINIC	0	01	CARPET	1994	SATISFACTORY	26	4	4
112	100	307	CLINIC	0	01	OTHER	1994	SATISFACTORY	26	4	4
113	105	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1994	SATISFACTORY	26	4	4
114	105	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1994	SATISFACTORY	26	4	4
115	105	301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	01	CARPET	1994	SATISFACTORY	26	4	4
116	30	331	CUSTODIAL SERVICE CLOSET	0	01	OTHER	1994	SATISFACTORY	26	4	4
117	80	307	CLINIC	0	01	CARPET	1994	SATISFACTORY	26	4	4
118	117	303	SECRETARIAL SPACE	0	01	CARPET	1994	SATISFACTORY	26	4	4
119	56	702	MECHANICAL ROOM	0	01	CONCRETE	1994	SATISFACTORY	26	4	4
120	132	306	CONFERENCE ROOM	0	01	CARPET	1994	SATISFACTORY	26	4	4
121	33	821	STAFF RESTROOM (BOTH SEXES)	0	01	CERAMIC TILE	1994	SATISFACTORY	26	4	4
122	33	821	STAFF RESTROOM (BOTH SEXES)	0	01	CERAMIC TILE	1994	SATISFACTORY	26	4	4
123	33	821	STAFF RESTROOM (BOTH SEXES)	0	01	CERAMIC TILE	1994	SATISFACTORY	26	4	4
124	33	821	STAFF RESTROOM (BOTH SEXES)	0	01	CERAMIC TILE	1994	SATISFACTORY	26	4	4
125	96	307	CLINIC	0	01	OTHER	1994	SATISFACTORY	26	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

126	12	308	GENERAL SCHOOL STORAGE	0	01	OTHER	1994	SATISFACTORY	26	4	4
127	42	702	MECHANICAL ROOM	0	01	CONCRETE	1994	SATISFACTORY	26	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	4,255	0	0	0				
TOTAL	4,255	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 27 - Building Number 00027

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: INDIVIDUAL UNITS
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: OIL
Year Constructed: 1995	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: CENTRAL HOT AIR
Year Modified:	Educational TV: COMMERCIAL ANTENNA	Heat Capacity: ADEQUATE
Average Age NSF: 1995	Intercom: NONE	Walls: OTHER
Relocatable Units: 0	Telephone: COMPLETE TO ALL ROOMS	Struct Comp: COMBINATION OF 1-3
Stories: 1		Corridor: SINGLE INSIDE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
100	132	700	INSIDE CIRCULATION	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
100A	2953	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
100B	1254	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
100C	56	707	TELEPHONE EQUIPMENT/COMMUNICATION CLOSET	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
100D	34	822	PUBLIC USE RESTROOM (MALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
100E	34	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
100F	168	822	PUBLIC USE RESTROOM (MALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
100G	168	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
100H	159	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
100J	159	822	PUBLIC USE RESTROOM (MALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
100K	313	810	MATERIAL STORAGE (LARGE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

100L	1246	701	COVERED WALKWAY	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
101	6402	380	LIBRARY (READING ROOM/STACKS)	0	01	CARPET	1995	SATISFACTORY	27	4	4
101A	148	700	INSIDE CIRCULATION	0	01	CARPET	1995	SATISFACTORY	27	4	4
102	494	382	PROFESSIONAL LIBRARY	0	01	CARPET	1995	SATISFACTORY	27	4	4
103	295	384	PERIODICAL STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4
103A	20	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
104	707	387	MEDIA PRODUCTION LAB	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
105	905	390	MEDIA GROUP PROJECTS/INSTRUCTION	0	01	CARPET	1995	SATISFACTORY	27	4	4
106	767	391	MEDIA MAINTENANCE/REPAIR	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
107	353	707	TELEPHONE EQUIPMENT/COMMUNICATION CLOSET	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
108	593	381	MEDIA TECHNICAL PROCESSING	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
108A	37	821	STAFF RESTROOM (BOTH SEXES)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
109	296	385	CLOSED CIRCUIT TV LAB	0	01	CARPET	1995	SATISFACTORY	27	4	4
109A	197	386	CLOSED CIRCUIT STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4
110	493	272	VOCATIONAL LAB SUPPORT SPACE	0	01	CARPET	1995	SATISFACTORY	27	4	4
111	477	306	CONFERENCE ROOM	0	01	CARPET	1995	SATISFACTORY	27	4	4
112	773	390	MEDIA GROUP PROJECTS/INSTRUCTION	0	01	CARPET	1995	SATISFACTORY	27	4	4
113	128	703	ELECTRICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
200	731	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
200A	80	331	CUSTODIAL SERVICE CLOSET	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
201	338	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
202	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
202A	88	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

203	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
203A	93	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
204	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
205	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
206	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
207	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
208	181	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
209	181	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
210	76	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
211	96	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
212	96	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
213	112	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
300	1825	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
300A	640	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
300B	72	331	CUSTODIAL SERVICE CLOSET	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
300C	34	822	PUBLIC USE RESTROOM (MALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
300D	34	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
301	1390	23	SENIOR HIGH SCIENCE LAB (9-12)	25	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
301A	173	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
301B	58	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4
302	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
302A	152	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
303	1390	23	SENIOR HIGH SCIENCE LAB (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
304	1390	23	SENIOR HIGH SCIENCE LAB (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

305	1390	23	SENIOR HIGH SCIENCE LAB (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
306	1390	23	SENIOR HIGH SCIENCE LAB (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
307	2028	270	WORK EVALUATION LAB	0	01	CARPET	1995	SATISFACTORY	27	4	4
307A	293	334	CUSTODIAL EQUIPMENT STORAGE	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
307B	88	803	INSTRUCTIONAL DARKROOM	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
307C	102	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
307D	248	851	VOCATIONAL TOOL STORAGE (LARGE)	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
307E	52	707	TELEPHONE EQUIPMENT/COMMUNICATION CLOSET	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
307F	80	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
308	1152	12	SENIOR HIGH SKILLS LAB (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
308A	101	812	PROJECT STORAGE	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
308B	117	808	MATERIAL STORAGE	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
309	745	852	VOCATIONAL TECHNOLOGY RESOURCE CENTER	0	01	CARPET	1995	SATISFACTORY	27	4	4
310	155	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
311	147	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4
311A	157	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
311B	98	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4
312	147	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4
312A	157	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
312B	98	808	MATERIAL STORAGE	0	01	CARPET	1995	SATISFACTORY	27	4	4
313	27	703	ELECTRICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
314	138	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
315	88	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

316	171	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
316A	68	703	ELECTRICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
317	88	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
318	88	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
400	936	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
401	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
402	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
403	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
404	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
405	448	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
406	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
407	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
408	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
409	801	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	1995	SATISFACTORY	27	4	4
410	181	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
411	181	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
412	181	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
413	181	315	TEACHER PLANNING OFFICE	0	01	CARPET	1995	SATISFACTORY	27	4	4
414	96	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
415	96	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
416	96	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
417	96	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
418	72	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
419	72	703	ELECTRICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

500	1873	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
500A	357	816	STUDENT RESTROOM (FEMALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
500B	357	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
500C	118	334	CUSTODIAL EQUIPMENT STORAGE	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
500D	235	810	MATERIAL STORAGE (LARGE)	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
501	5979	340	DINING AREA	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
502	820	316	TEACHER LOUNGE/DINING	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
503	87	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
503A	36	820	STAFF RESTROOM (FEMALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
503B	36	820	STAFF RESTROOM (FEMALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
504	87	700	INSIDE CIRCULATION	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
504A	36	819	STAFF RESTROOM (MALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
504B	36	819	STAFF RESTROOM (MALE)	0	01	CERAMIC TILE	1995	SATISFACTORY	27	4	4
505	84	350	OTHER FOOD SERVICE	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
506	1081	341	KITCHEN & SERVING AREA	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
507	327	341	KITCHEN & SERVING AREA	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
508	1666	341	KITCHEN & SERVING AREA	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
509	317	347	KITCHEN DISH WASHING	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
510	120	340	DINING AREA	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
511	73	350	OTHER FOOD SERVICE	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
512	551	342	KITCHEN DRY STORAGE	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
513	147	350	OTHER FOOD SERVICE	0	01	OTHER	1995	SATISFACTORY	27	4	4
514	227	350	OTHER FOOD SERVICE	0	01	OTHER	1995	SATISFACTORY	27	4	4
515	103	331	CUSTODIAL SERVICE CLOSET	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

516	48	350	OTHER FOOD SERVICE	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
517	103	350	OTHER FOOD SERVICE	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
517A	40	819	STAFF RESTROOM (MALE)	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
517B	40	820	STAFF RESTROOM (FEMALE)	0	01	COMPOSITION TILE	1995	SATISFACTORY	27	4	4
518	75	344	KITCHEN GARBAGE WASH	0	01	QUARRY TILE	1995	SATISFACTORY	27	4	4
519	131	703	ELECTRICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
520	59	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
521	44	703	ELECTRICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
522	83	702	MECHANICAL ROOM	0	01	CONCRETE	1995	SATISFACTORY	27	4	4
523	4136	340	DINING AREA	0	01	CONCRETE	1995	SATISFACTORY	27	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	72,567	525	0	0				
TOTAL	72,567	525	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 28 - Building Number 00028

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: CENTRAL
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: ELECTRIC
Year Constructed: 1997	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: CENTRAL HOT AIR
Year Modified:	Educational TV: NONE	Heat Capacity: ADEQUATE
Average Age NSF: 1997	Intercom: NONE	Walls: HOLLOW BLOCK
Relocatable Units: 0	Telephone: NONE	Struct Comp: COMBINATION OF 1-3
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
100	341	93	P E LOCKER ROOM (FEMALE)	0	01	CERAMIC TILE	1997	SATISFACTORY	28	4	4
101	341	93	P E LOCKER ROOM (FEMALE)	0	01	CERAMIC TILE	1997	SATISFACTORY	28	4	4
102	195	98	P E STORAGE (MIDDLE-SR HIGH)	0	01	CONCRETE	1997	SATISFACTORY	28	4	4
103	44	822	PUBLIC USE RESTROOM (MALE)	0	01	CERAMIC TILE	1997	SATISFACTORY	28	4	4
104	44	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CERAMIC TILE	1997	SATISFACTORY	28	4	4
105	195	98	P E STORAGE (MIDDLE-SR HIGH)	0	01	CONCRETE	1997	SATISFACTORY	28	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	1,160	0	0	0				
TOTAL	1,160	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 29 - FIELDHOUSE

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: CENTRAL
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: ELECTRIC
Year Constructed: 2006	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: CENTRAL HOT AIR
Year Modified:	Educational TV: NONE	Heat Capacity: ADEQUATE
Average Age NSF: 2006	Intercom: NONE	Walls: COMBINATION OF 1-5
Relocatable Units: 0	Telephone: PARTIAL SYSTEM	Struct Comp: COMBINATION OF 1-3
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
100	383	371	CONCESSIONS	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
101	212	822	PUBLIC USE RESTROOM (MALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
102	212	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
103	123	315	TEACHER PLANNING OFFICE	0	01	COMPOSITION TILE	2006	SATISFACTORY	29	4	4
104	40	331	CUSTODIAL SERVICE CLOSET	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
105	167	116	P E TRAINING ROOM	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
106	738	92	P E LOCKER ROOM (MALE)	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
107	1097	92	P E LOCKER ROOM (MALE)	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
108	212	823	PUBLIC USE RESTROOM (FEMALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
109	212	822	PUBLIC USE RESTROOM (MALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
110	383	371	CONCESSIONS	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
111	144	703	ELECTRICAL ROOM	0	01	CONCRETE	2006	SATISFACTORY	29	4	4

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

112	76	372	TICKET BOOTH	0	01	CONCRETE	2006	SATISFACTORY	29	4	4
113	160	94	P E SHOWER (MALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
113A	110	700	INSIDE CIRCULATION	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
114	311	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
115	85	700	INSIDE CIRCULATION	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
116	32	331	CUSTODIAL SERVICE CLOSET	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
117	79	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
118	267	315	TEACHER PLANNING OFFICE	0	01	COMPOSITION TILE	2006	SATISFACTORY	29	4	4
119	473	121	OTHER P E SPACE	0	01	COMPOSITION TILE	2006	SATISFACTORY	29	4	4
120	112	98	P E STORAGE (MIDDLE-SR HIGH)	0	01	COMPOSITION TILE	2006	SATISFACTORY	29	4	4
121	85	700	INSIDE CIRCULATION	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
122	311	815	STUDENT RESTROOM (MALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
123	160	94	P E SHOWER (MALE)	0	01	CERAMIC TILE	2006	SATISFACTORY	29	4	4
123A	110	700	INSIDE CIRCULATION	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
124	76	372	TICKET BOOTH	0	01	CONCRETE	2006	SATISFACTORY	29	4	4
125	144	702	MECHANICAL ROOM	0	01	CONCRETE	2006	SATISFACTORY	29	4	4
126	57	700	INSIDE CIRCULATION	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
127	93	700	INSIDE CIRCULATION	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4
128	93	700	INSIDE CIRCULATION	0	01	QUARRY TILE	2006	SATISFACTORY	29	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	6,757	0	0	0				
TOTAL	6,757	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 30 - WELDING SHOP

Owner: SCHOOL BOARD	Light: ADEQUATE	Cooling: INDIVIDUAL UNITS
Use: SENIOR HIGH	Mech Vent: ADEQUATE	Heat Source: ELECTRIC
Year Constructed: 2014	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: COMBINATION OF SYSTEMS
Year Modified:	Educational TV: NONE	Heat Capacity: ADEQUATE
Average Age NSF: 2014	Intercom: TWO WAY COMPLETE	Walls: OTHER
Relocatable Units: 0	Telephone: NONE	Struct Comp: STEEL
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
101	2384	245	MEDIUM INDUSTRIAL LAB	20	01	CONCRETE	2014	SATISFACTORY	30	4	4
102	662	840	VOCATIONAL RELATED CLASSROOM	0	01	CONCRETE	2014	SATISFACTORY	30	4	4
103	240	850	VOCATIONAL TOOL STORAGE (SMALL)	0	01	CONCRETE	2014	SATISFACTORY	30	4	4
104	254	810	MATERIAL STORAGE (LARGE)	0	01	CONCRETE	2014	SATISFACTORY	30	4	4
105	60	701	COVERED WALKWAY	0	01	CONCRETE	2014	SATISFACTORY	30	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Permanent	3,600	20	0	0				
TOTAL	3,600	20	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

DISTRICT: 65 WAKULLA COUNTY SCHOOL DISTRICT

FACILITY: 4-A WAKULLA SENIOR HIGH

BUILDING: 99

Owner: LEASE RENT	Light: ADEQUATE	Cooling: INDIVIDUAL UNITS
Use: SENIOR HIGH	Mech Vent: NONE	Heat Source: ELECTRIC
Year Constructed: 2015	Artificial Lighting: SHIELDED FLORESCENT	Heat Distribution: CENTRAL HOT AIR
Year Modified:	Educational TV: NONE	Heat Capacity: ADEQUATE
Average Age NSF: 2015	Intercom: TWO WAY COMPLETE	Walls: RELOCATABLE
Relocatable Units: 6	Telephone: PARTIAL SYSTEM	Struct Comp: RELOCATABLE
Stories: 1		Corridor: NONE

ROOM	NET SQ FT	DESIGN CODE	DESCRIPTION	STU STA	FLR LOC	FLOOR COVER	YEAR CONST	CONDITION	BLDG	PAR	FAC
001	831	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	2015	SATISFACTORY	99	4	4
002	831	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	2015	SATISFACTORY	99	4	4
003	831	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	2015	SATISFACTORY	99	4	4
004	831	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	2015	SATISFACTORY	99	4	4
005	831	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	2015	SATISFACTORY	99	4	4
006	831	3	SENIOR HIGH CLASSROOM (9-12)	25	01	CARPET	2015	SATISFACTORY	99	4	4

	Satisfactory		Unsatisfactory		Failed Standards		Scheduled For Replacement	
	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations	Square Feet	Student Stations
Relocatable	4,986	150	0	0	0	0	0	0
TOTAL	4,986	150	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

STUDENT STATIONS BY DESIGN CODE FOR:

FACILITY: WAKULLA SENIOR HIGH

		Satis Stu Sta			Unsat Stu Sta			Sat	Unsat	Satis Rooms			Unsatis Rooms			Fail Std Stu Sta	Repl Stu Sta	Fail Std Rooms	Repl Rooms
Design Code	Design Code Description	Perm	Mod	Relo	Perm	Mod	Relo	Tot	Tot	Perm	Mod	Relo	Perm	Mod	Relo	Relo	Relo	Relo	Relo
00003	SENIOR HIGH CLASSROOM (9-12)	800	0	150	0	0	0	950	0	32	0	6	0	0	0	0	0	0	0
00012	SENIOR HIGH SKILLS LAB (9-12)	25	0	0	0	0	0	25	0	1	0	0	0	0	0	0	0	0	0
00022	SENIOR HIGH SCIENCE DEMO (9-12)	50	0	0	0	0	0	50	0	2	0	0	0	0	0	0	0	0	0
00023	SENIOR HIGH SCIENCE LAB (9-12)	150	0	0	0	0	0	150	0	6	0	0	0	0	0	0	0	0	0
00032	SENIOR HIGH OPEN PLAN (9-12)	50	0	0	0	0	0	50	0	1	0	0	0	0	0	0	0	0	0
00040	RESOURCE ROOM	0	0	0	0	0	0	0	0	5	0	0	0	0	0	0	0	0	0
00052	ART - SENIOR HIGH	58	0	0	0	0	0	58	0	3	0	0	0	0	0	0	0	0	0
00061	E S E PART-TIME	45	0	0	0	0	0	45	0	3	0	0	0	0	0	0	0	0	0
00062	E S E FULL-TIME	20	0	0	0	0	0	20	0	2	0	0	0	0	0	0	0	0	0
00068	E S E TIME-OUT ROOM	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00076	BAND CLASS (MIDDLE-SR HIGH)	50	0	0	0	0	0	50	0	1	0	0	0	0	0	0	0	0	0
00083	MUSIC RELATED SPACE	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00090	P E DRESSING ROOM (MALE)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00092	P E LOCKER ROOM (MALE)	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00093	P E LOCKER ROOM (FEMALE)	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00094	P E SHOWER (MALE)	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0
00095	P E SHOWER (FEMALE)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00098	P E STORAGE (MIDDLE-SR HIGH)	0	0	0	0	0	0	0	0	5	0	0	0	0	0	0	0	0	0
00110	P E MULTIPURPOSE ROOM (MIDDLE-SR HIGH)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00112	SR HIGH GYMNASIUM	70	0	0	0	0	0	70	0	1	0	0	0	0	0	0	0	0	0
00114	P E LAUNDRY	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00116	P E TRAINING ROOM	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00117	P E WEIGHT ROOM	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00120	GYMNASIUM STORAGE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

		Satis Stu Sta			Unsat Stu Sta			Sat	Unsat	Satis Rooms			Unsatis Rooms			Fail Std Stu Sta	Repl Stu Sta	Fail Std Rooms	Repl Rooms
Design Code	Design Code Description	Perm	Mod	Relo	Perm	Mod	Relo	Tot	Tot	Perm	Mod	Relo	Perm	Mod	Relo	Relo	Relo	Relo	Relo
00121	OTHER P E SPACE	0	0	0	0	0	0	0	0	5	0	0	0	0	0	0	0	0	0
00212	BUSINESS EDUCATION LAB	10	0	0	0	0	0	10	0	1	0	0	0	0	0	0	0	0	0
00245	MEDIUM INDUSTRIAL LAB	37	0	0	0	0	0	37	0	2	0	0	0	0	0	0	0	0	0
00270	WORK EVALUATION LAB	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00271	VPI LAB	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00272	VOCATIONAL LAB SUPPORT SPACE	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0
00300	PRINCIPAL/DIRECTOR OFFICE	0	0	0	0	0	0	0	0	6	0	0	0	0	0	0	0	0	0
00301	ASSISTANT PRINCIPAL/OTHER OFFICE	0	0	0	0	0	0	0	0	26	0	0	0	0	0	0	0	0	0
00303	SECRETARIAL SPACE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00304	RECEPTION AREA	0	0	0	0	0	0	0	0	5	0	0	0	0	0	0	0	0	0
00305	PRODUCTION WORKROOM	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00306	CONFERENCE ROOM	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00307	CLINIC	0	0	0	0	0	0	0	0	8	0	0	0	0	0	0	0	0	0
00308	GENERAL SCHOOL STORAGE	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0
00309	VAULT/STUDENT RECORDS	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00310	SCHOOL STORE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00312	COMPUTER AREA	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00313	CAREERS ROOM	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00315	TEACHER PLANNING OFFICE	0	0	0	0	0	0	0	0	33	0	0	0	0	0	0	0	0	0
00316	TEACHER LOUNGE/DINING	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00317	GENERAL SCHOOL SPACE	0	0	0	0	0	0	0	0	7	0	0	0	0	0	0	0	0	0
00330	CUSTODIAL RECEIVING	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00331	CUSTODIAL SERVICE CLOSET	0	0	0	0	0	0	0	0	8	0	0	0	0	0	0	0	0	0
00332	CUSTODIAL WORK AREA	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00333	FLAMMABLE STORAGE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00334	CUSTODIAL EQUIPMENT STORAGE	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

		Satis Stu Sta			Unsat Stu Sta			Sat	Unsat	Satis Rooms			Unsatis Rooms			Fail Std Stu Sta	Repl Stu Sta	Fail Std Rooms	Repl Rooms
Design Code	Design Code Description	Perm	Mod	Relo	Perm	Mod	Relo	Tot	Tot	Perm	Mod	Relo	Perm	Mod	Relo	Relo	Relo	Relo	Relo
00340	DINING AREA	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00341	KITCHEN & SERVING AREA	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0
00342	KITCHEN DRY STORAGE	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00343	KITCHEN OFFICE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00344	KITCHEN GARBAGE WASH	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00346	KITCHEN FOOD PREPARATION	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00347	KITCHEN DISH WASHING	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00350	OTHER FOOD SERVICE	0	0	0	0	0	0	0	0	8	0	0	0	0	0	0	0	0	0
00360	AUDITORIUM	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00363	STAGE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00364	STAGE STORAGE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00365	STAGE DRESSING ROOM (MALE)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00366	STAGE DRESSING ROOM (FEMALE)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00367	CONTROL BOOTH/PROJECTION ROOM	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00371	CONCESSIONS	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00372	TICKET BOOTH	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00380	LIBRARY (READING ROOM/STACKS)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00381	MEDIA TECHNICAL PROCESSING	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00382	PROFESSIONAL LIBRARY	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00384	PERIODICAL STORAGE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00385	CLOSED CIRCUIT TV LAB	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00386	CLOSED CIRCUIT STORAGE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00387	MEDIA PRODUCTION LAB	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00390	MEDIA GROUP PROJECTS/INSTRUCTION	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00391	MEDIA MAINTENANCE/REPAIR	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00700	INSIDE CIRCULATION	0	0	0	0	0	0	0	0	38	0	0	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

		Satis Stu Sta			Unsat Stu Sta			Sat	Unsat	Satis Rooms			Unsatis Rooms			Fail Std Stu Sta	Repl Stu Sta	Fail Std Rooms	Repl Rooms
Design Code	Design Code Description	Perm	Mod	Relo	Perm	Mod	Relo	Tot	Tot	Perm	Mod	Relo	Perm	Mod	Relo	Relo	Relo	Relo	Relo
00701	COVERED WALKWAY	0	0	0	0	0	0	0	0	9	0	0	0	0	0	0	0	0	0
00702	MECHANICAL ROOM	0	0	0	0	0	0	0	0	34	0	0	0	0	0	0	0	0	0
00703	ELECTRICAL ROOM	0	0	0	0	0	0	0	0	10	0	0	0	0	0	0	0	0	0
00707	TELEPHONE EQUIPMENT/COMMUNICATION CLOSET	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0
00708	JROTC	16	0	0	0	0	0	16	0	1	0	0	0	0	0	0	0	0	0
00801	FIRING RANGE (INDOOR)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00803	INSTRUCTIONAL DARKROOM	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00805	KILN	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00806	REFERENCE	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00808	MATERIAL STORAGE	0	0	0	0	0	0	0	0	29	0	0	0	0	0	0	0	0	0
00810	MATERIAL STORAGE (LARGE)	0	0	0	0	0	0	0	0	5	0	0	0	0	0	0	0	0	0
00812	PROJECT STORAGE	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00814	STUDENT RESTROOM (BOTH SEXES)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00815	STUDENT RESTROOM (MALE)	0	0	0	0	0	0	0	0	9	0	0	0	0	0	0	0	0	0
00816	STUDENT RESTROOM (FEMALE)	0	0	0	0	0	0	0	0	7	0	0	0	0	0	0	0	0	0
00817	STUDENT RESTROOM & BATH	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00819	STAFF RESTROOM (MALE)	0	0	0	0	0	0	0	0	6	0	0	0	0	0	0	0	0	0
00820	STAFF RESTROOM (FEMALE)	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00821	STAFF RESTROOM (BOTH SEXES)	0	0	0	0	0	0	0	0	7	0	0	0	0	0	0	0	0	0
00822	PUBLIC USE RESTROOM (MALE)	0	0	0	0	0	0	0	0	12	0	0	0	0	0	0	0	0	0
00823	PUBLIC USE RESTROOM (FEMALE)	0	0	0	0	0	0	0	0	11	0	0	0	0	0	0	0	0	0
00831	MUSIC PRACTICE ROOM	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0
00840	VOCATIONAL RELATED CLASSROOM	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
00842	KITCHEN (HOME ECONOMICS)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00850	VOCATIONAL TOOL STORAGE (SMALL)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00851	VOCATIONAL TOOL STORAGE (LARGE)	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0

FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

		Satis Stu Sta			Unsat Stu Sta			Sat	Unsat	Satis Rooms			Unsatis Rooms			Fail Std Stu Sta	Repl Stu Sta	Fail Std Rooms	Repl Rooms
Design Code	Design Code Description	Perm	Mod	Relo	Perm	Mod	Relo	Tot	Tot	Perm	Mod	Relo	Perm	Mod	Relo	Relo	Relo	Relo	Relo
00852	VOCATIONAL TECHNOLOGY RESOURCE CENTER	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00853	VOCATIONAL TESTING	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
00864	VOCATIONAL ISOLATION ROOM	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0
Totals:		1381	0	150	0	0	0	1531	0	467	0	6	0	0	0	0	0	0	0


FLORIDA INVENTORY OF SCHOOL HOUSES (FISH)

FACILITY INVENTORY REPORT

WAKULLA SENIOR HIGH SCHOOL


FISH

BUILDING PLANS

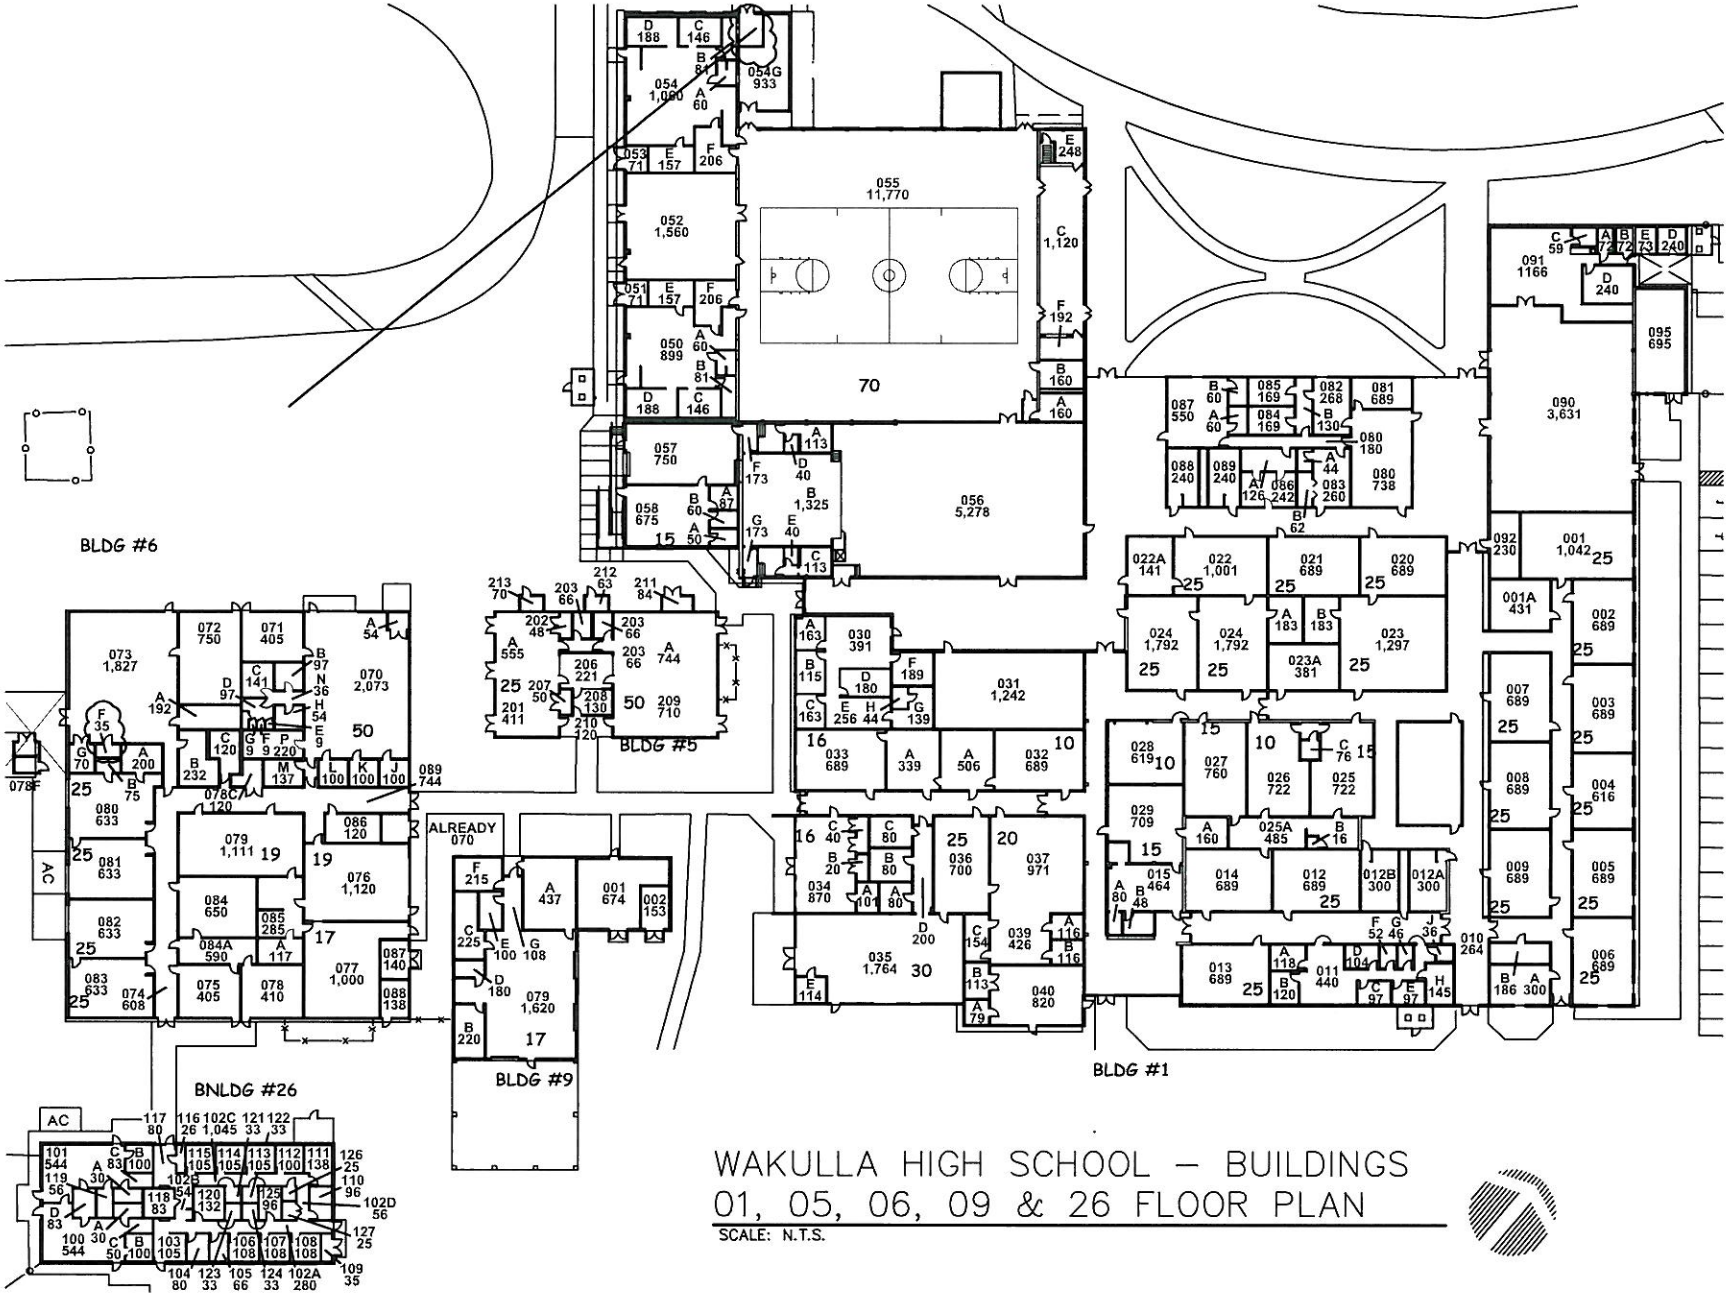

WAKULLA HIGH SCHOOL – BUILDINGS 01, 05, 06, 09 & 26 FLOOR PLAN

SCALE: N.T.S.

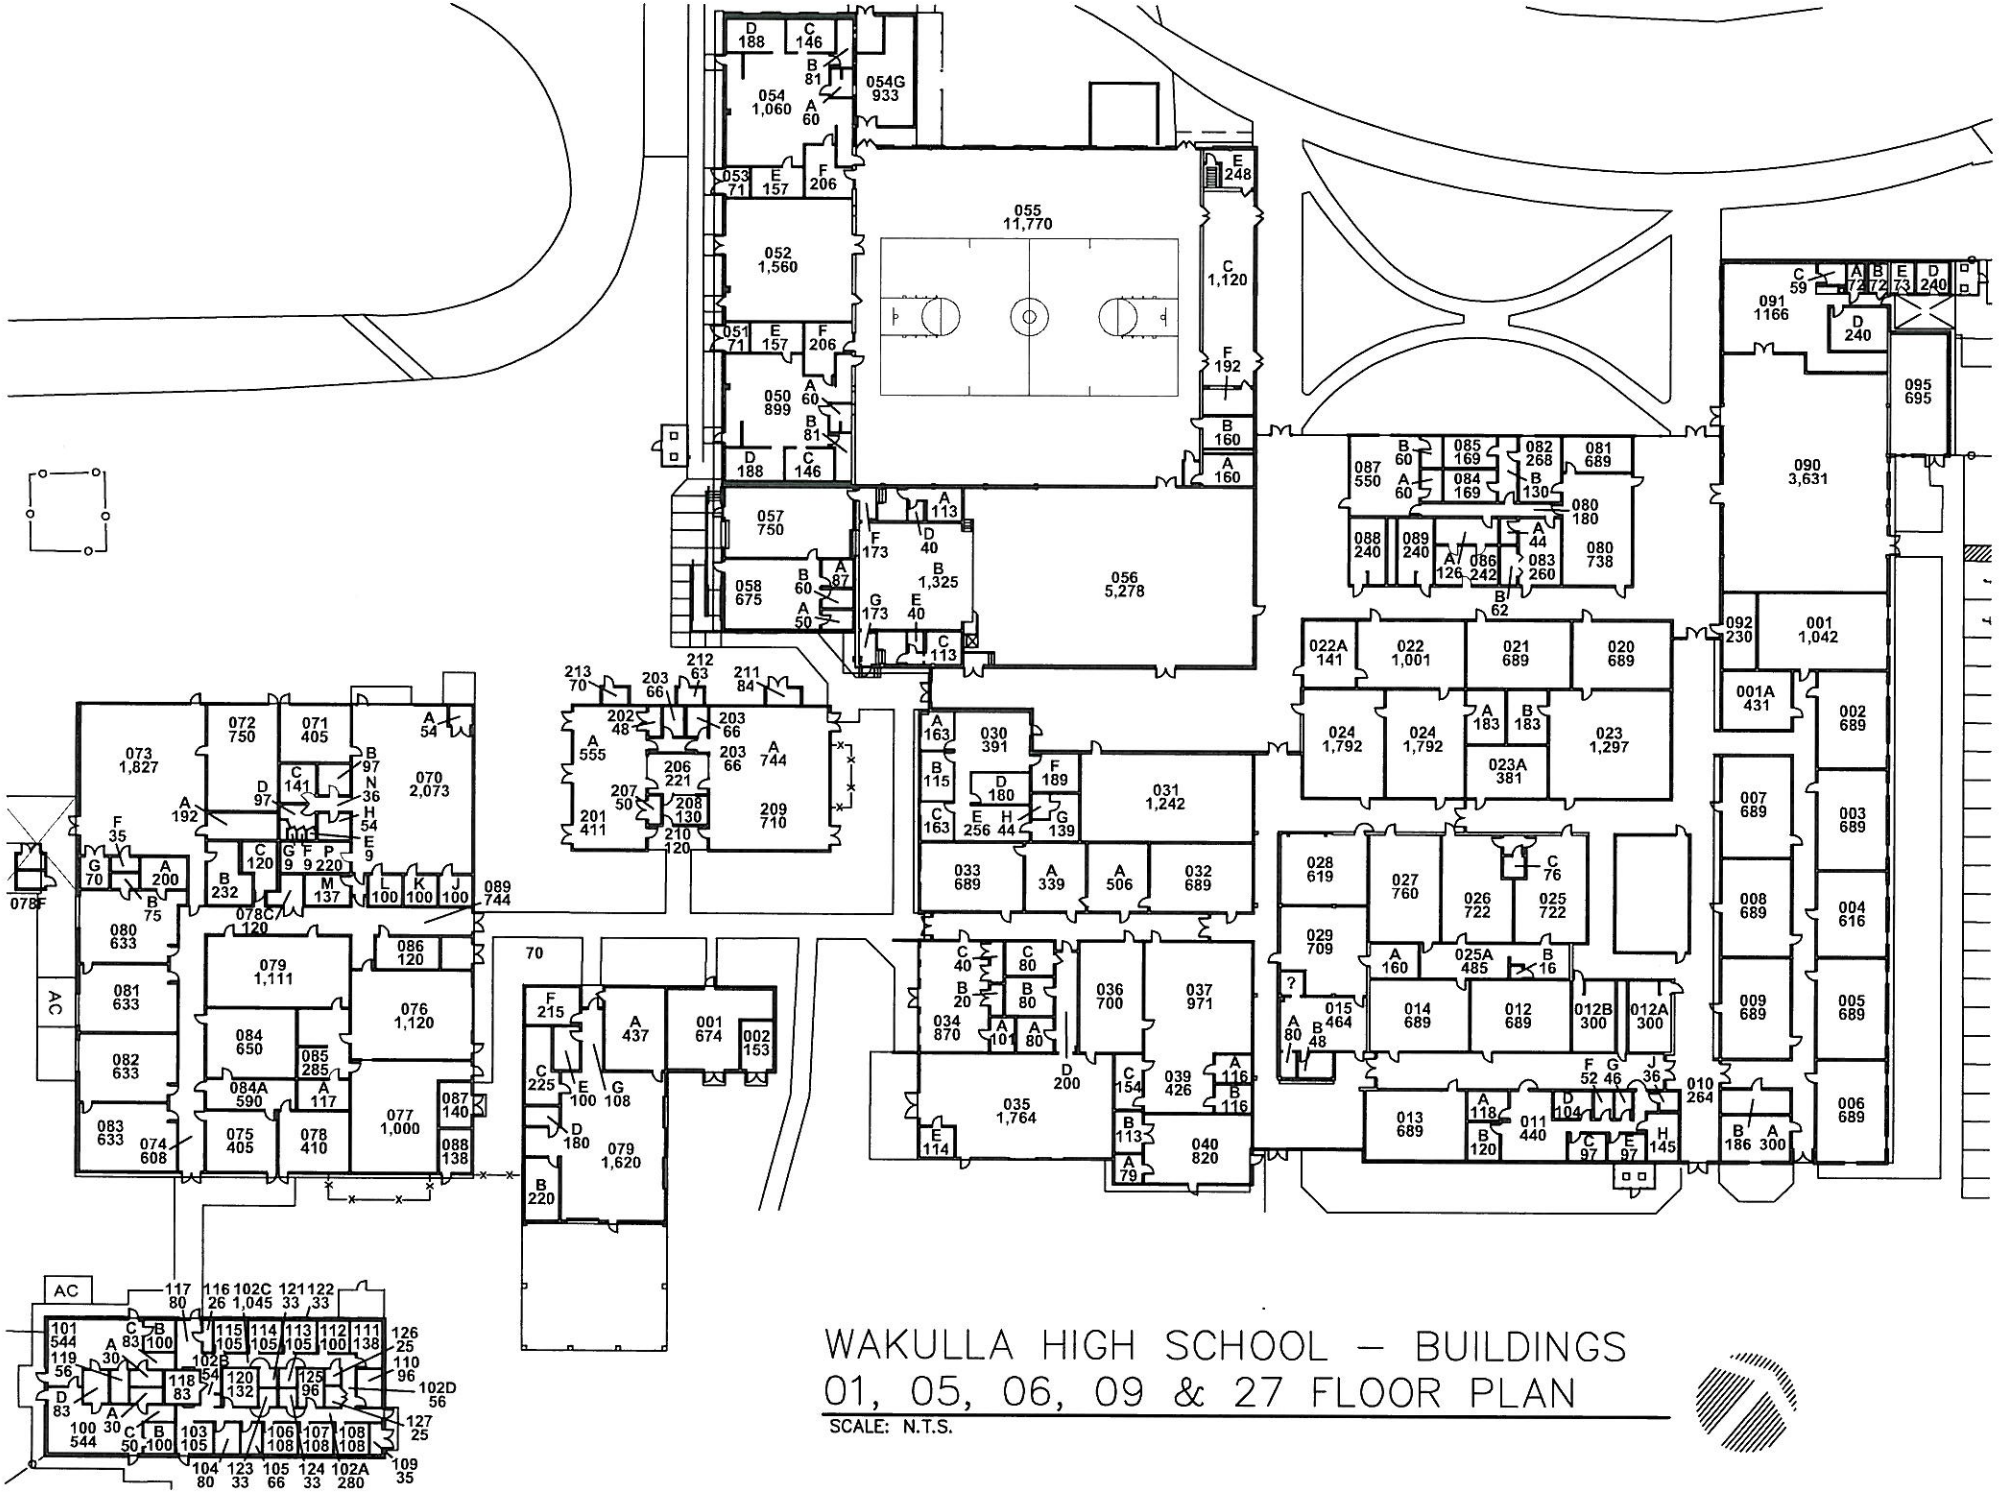



WAKULLA HIGH SCHOOL – BUILDINGS 01, 05, 06, 09 & 27 FLOOR PLAN

SCALE: N.T.S.

WAKULLA SENIOR HIGH SCHOOL


BUILDING PHOTOS

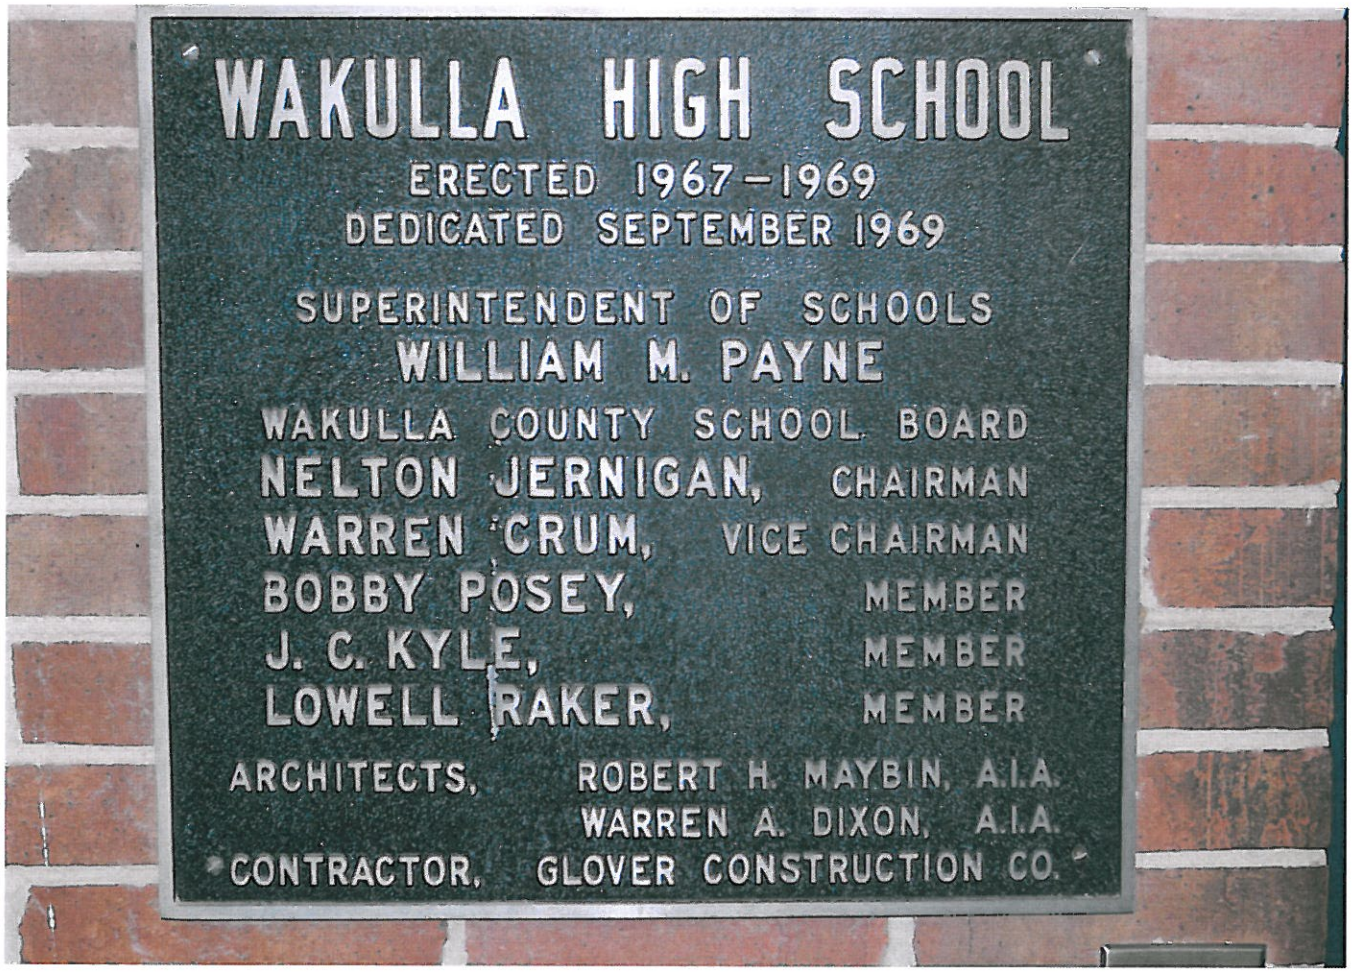
WAKULLA HIGH SCHOOL
ERECTED 1967-1969
DEDICATED SEPTEMBER 1969
SUPERINTENDENT OF SCHOOLS
WILLIAM M. PAYNE
WAKULLA COUNTY SCHOOL BOARD
NELTON JERNIGAN, CHAIRMAN
WARREN CRUM, VICE CHAIRMAN
BOBBY POSEY, MEMBER
J. C. KYLE, MEMBER
LOWELL RAKER, MEMBER
ARCHITECTS, ROBERT H. MAYBIN, A.I.A.
WARREN A. DIXON, A.I.A.
CONTRACTOR, GLOVER CONSTRUCTION CO.

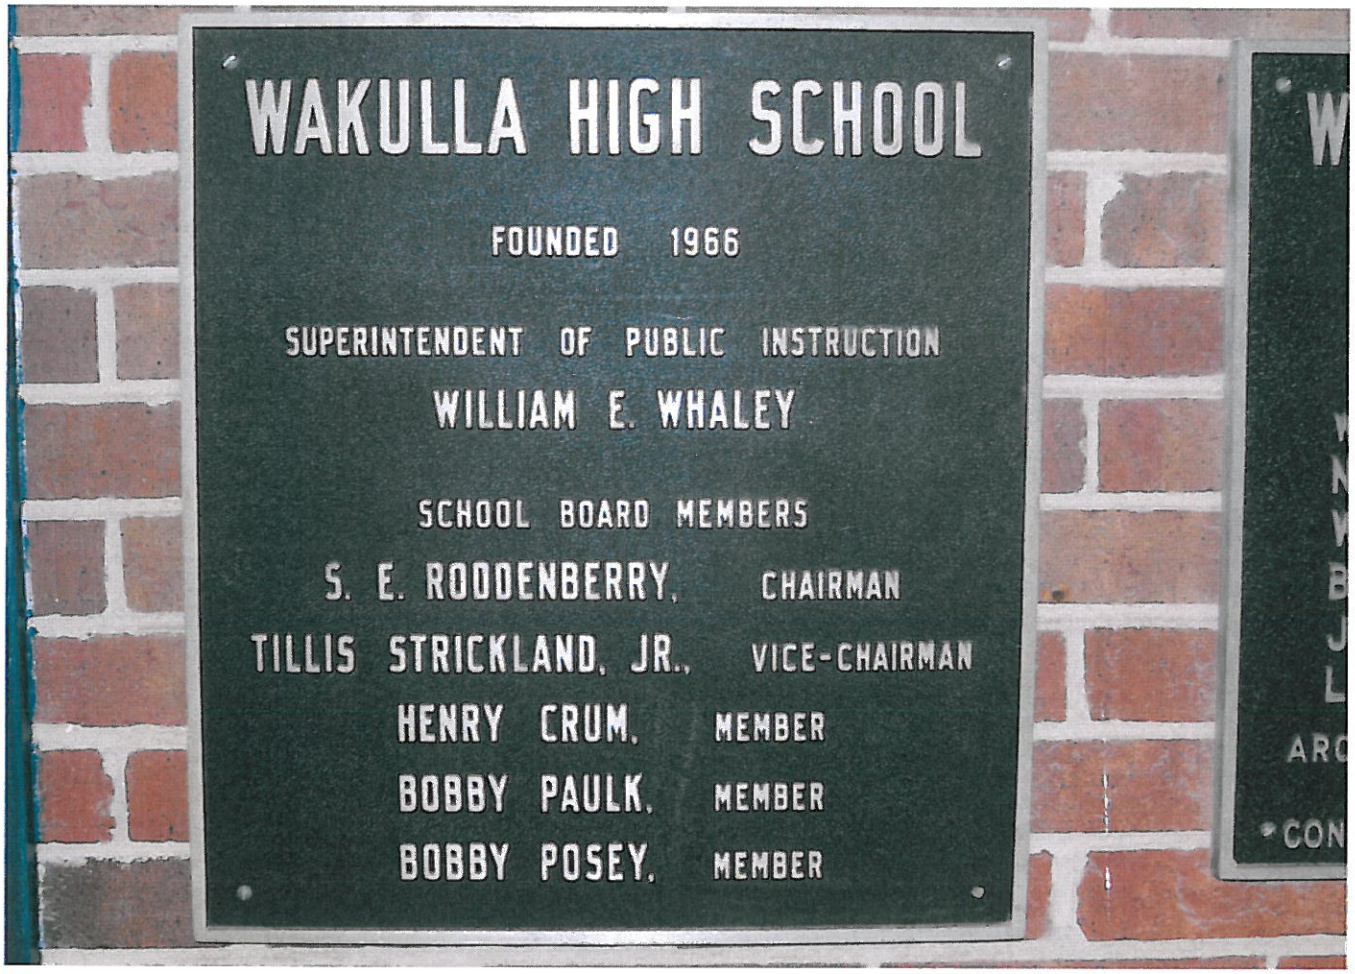
WAKULLA HIGH SCHOOL
FOUNDED 1966
SUPERINTENDENT OF PUBLIC INSTRUCTION
WILLIAM E. WHALEY
SCHOOL BOARD MEMBERS
S. E. RODDENBERRY, CHAIRMAN
TILLIS STRICKLAND, JR., VICE-CHAIRMAN
HENRY CRUM, MEMBER
BOBBY PAULK, MEMBER
BOBBY POSEY, MEMBER





WAKULLA HIGH SCHOOL

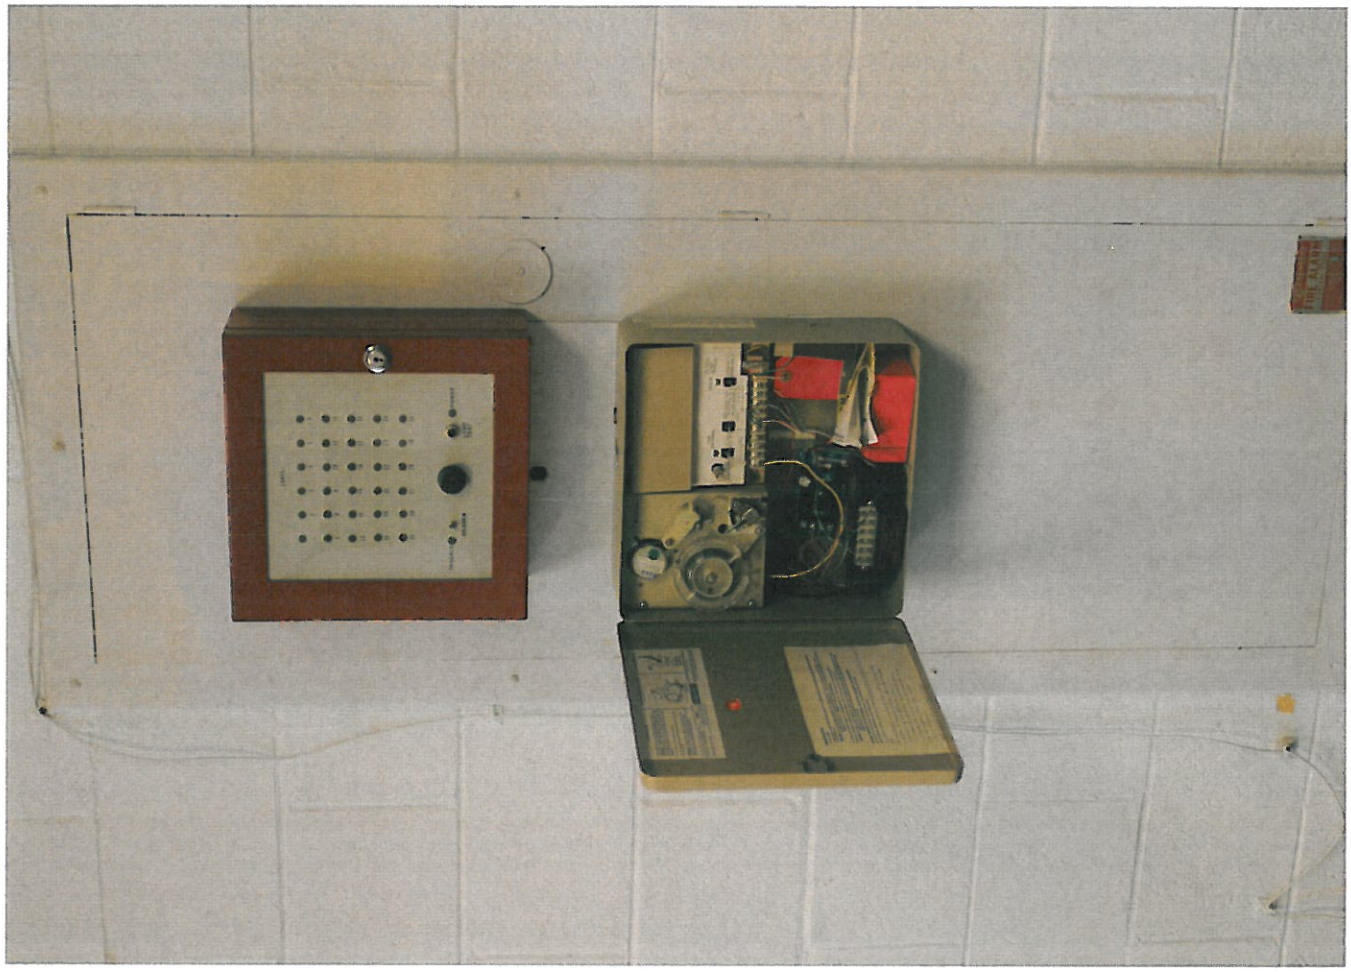






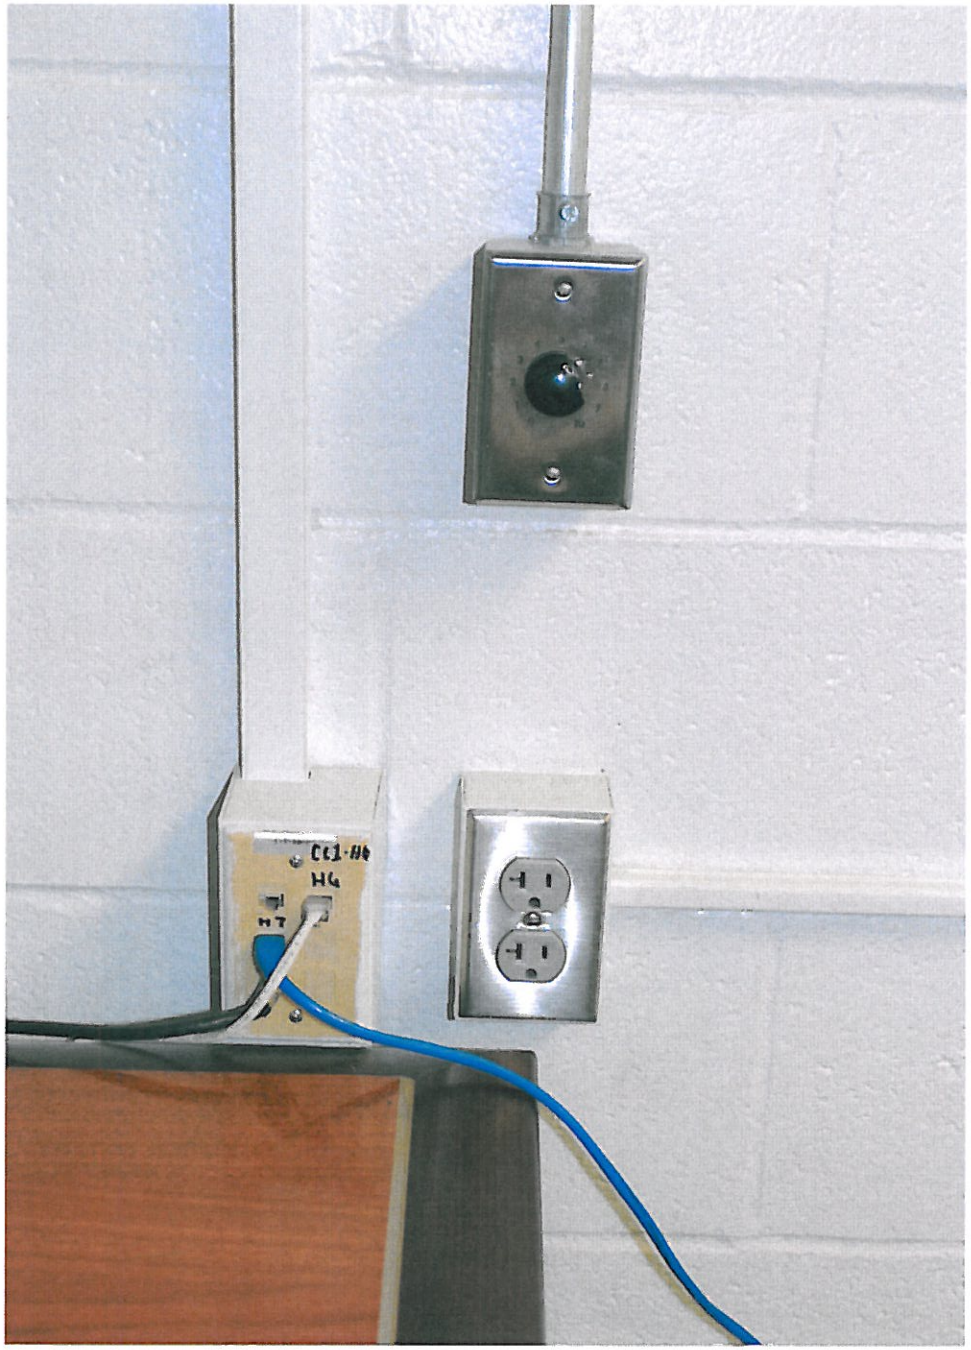




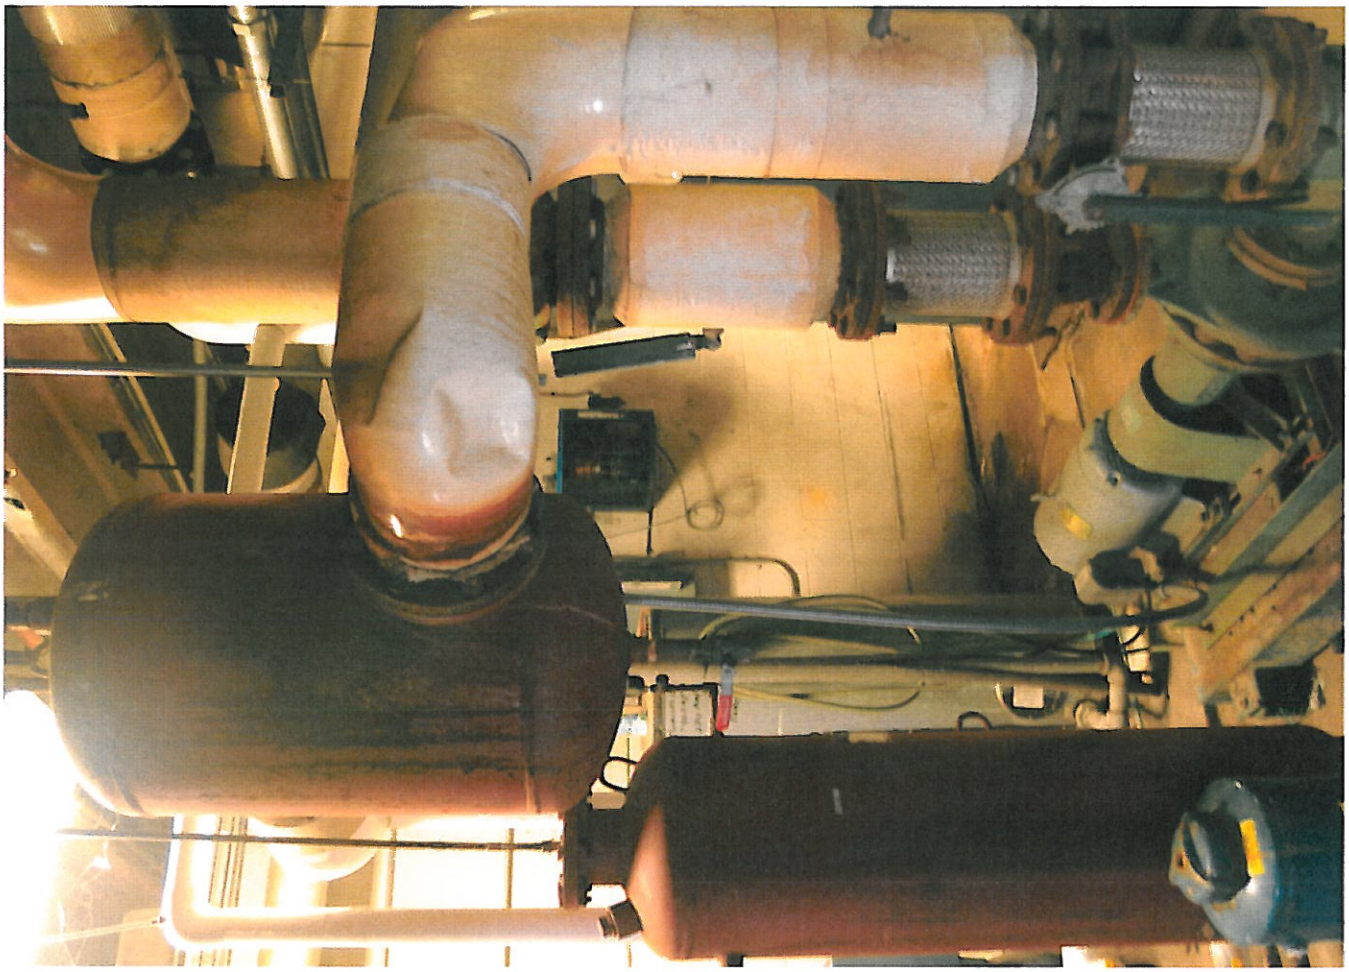







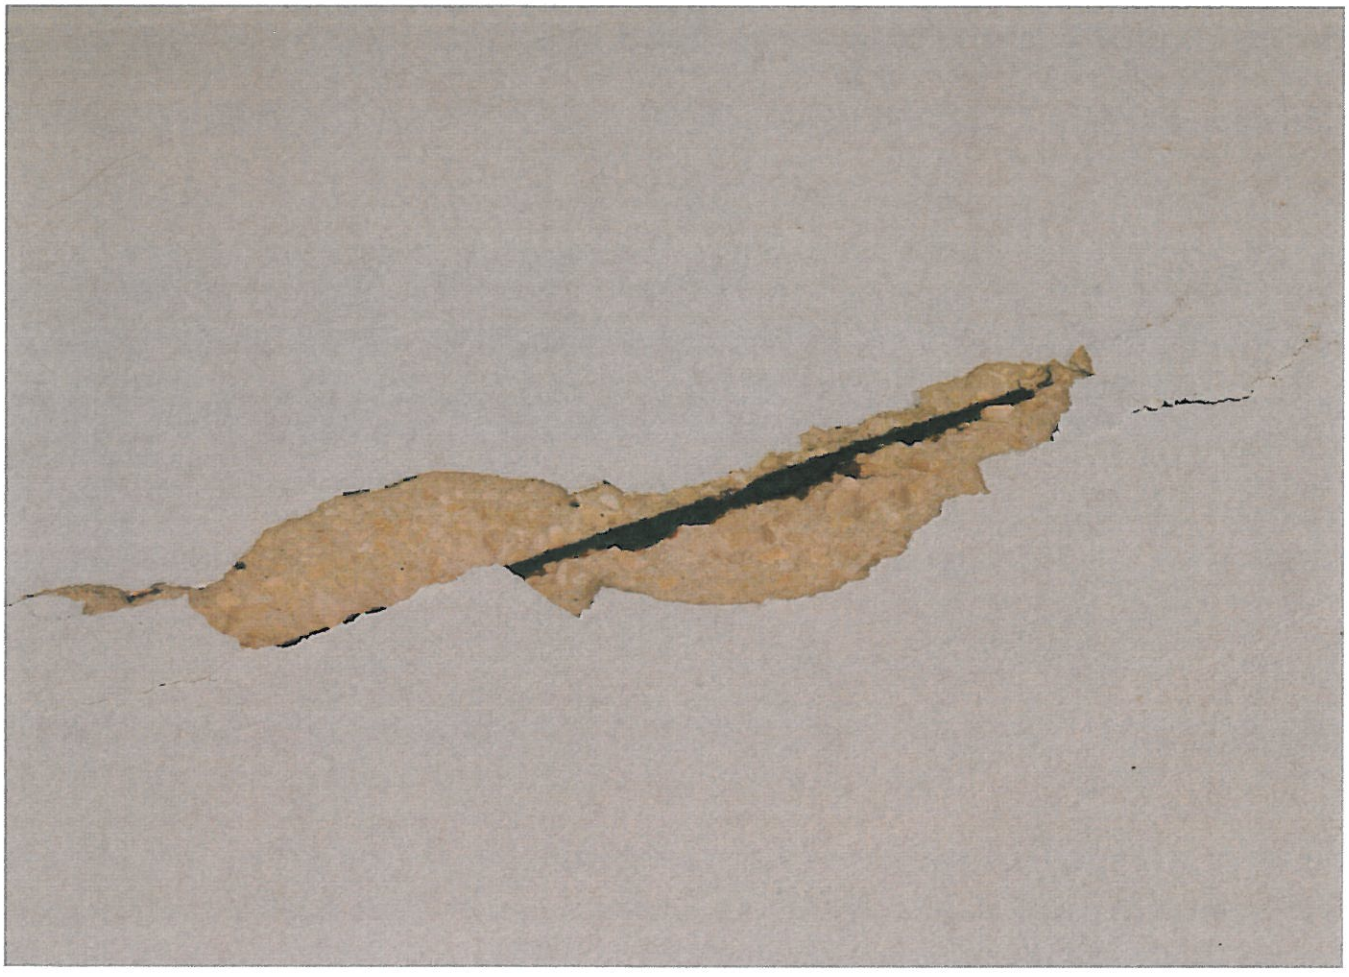












DampRid
GREAT EXPECTATIONS
CHARLES DICKENS





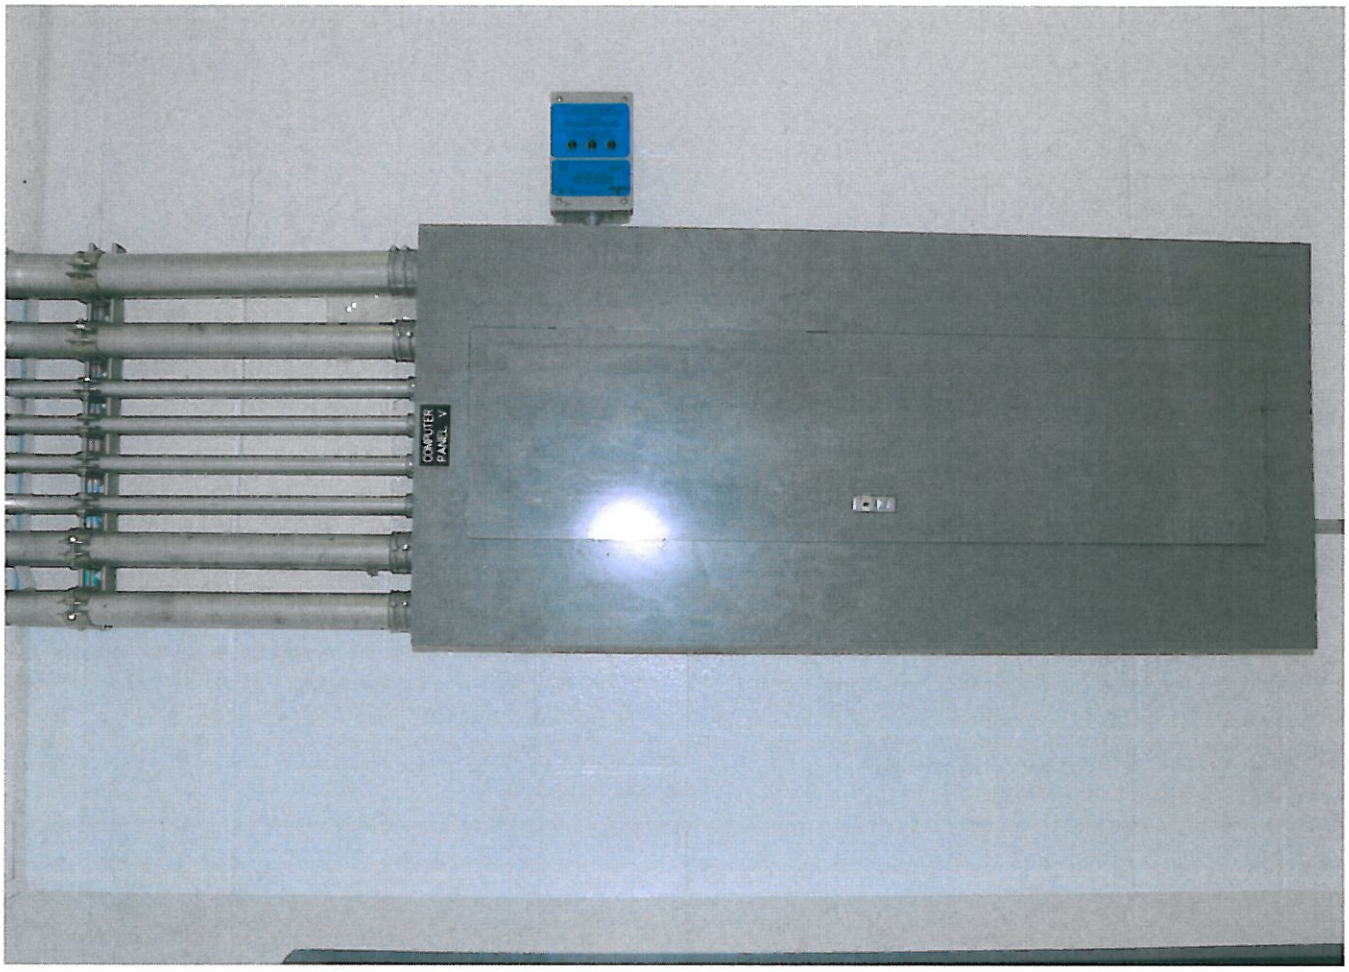



COMPUTER
PANEL

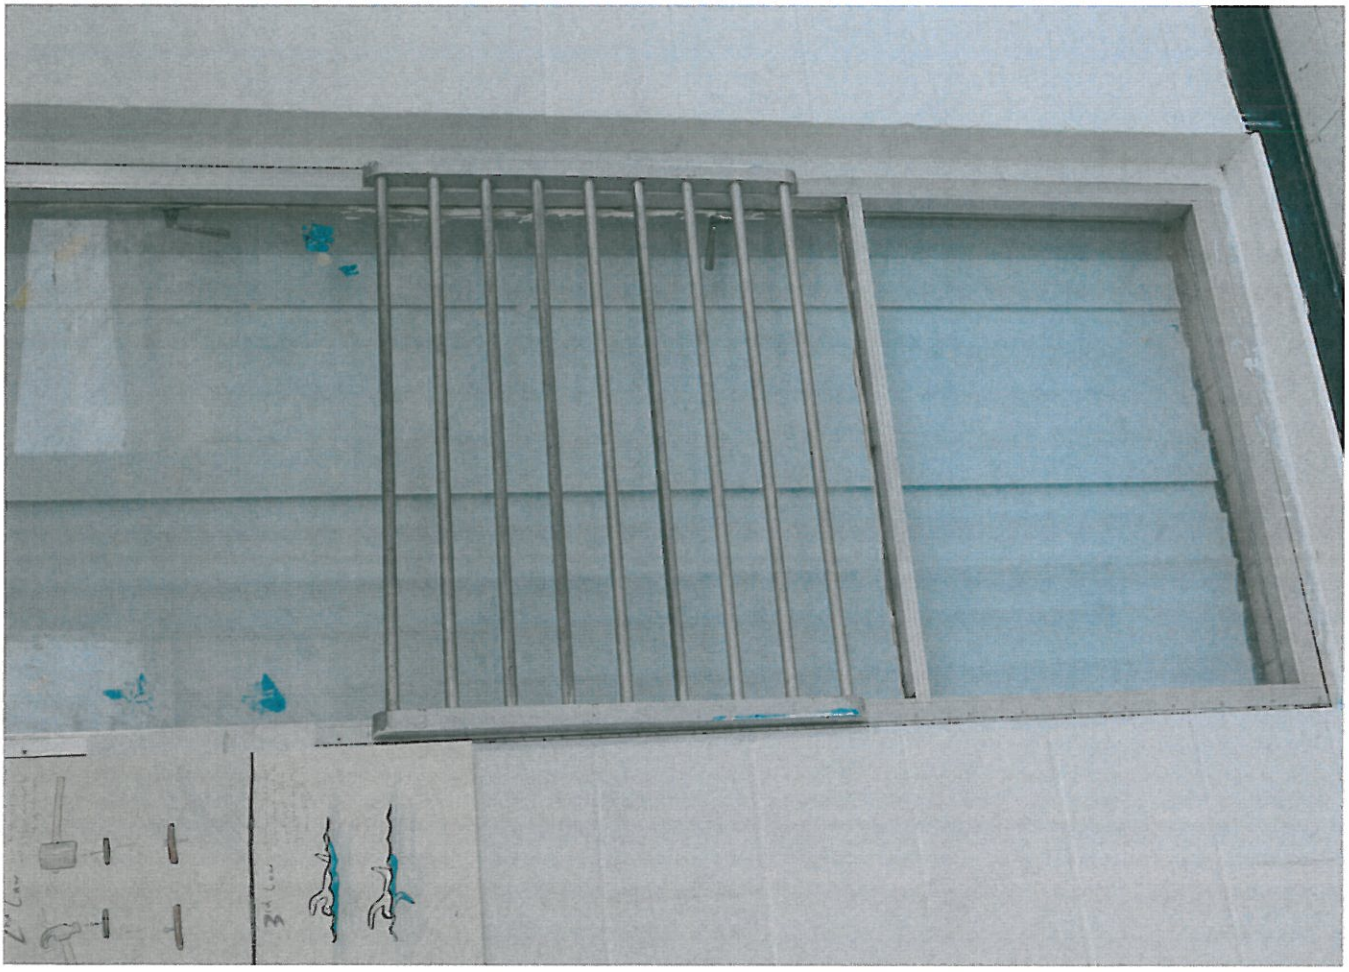





EXIT



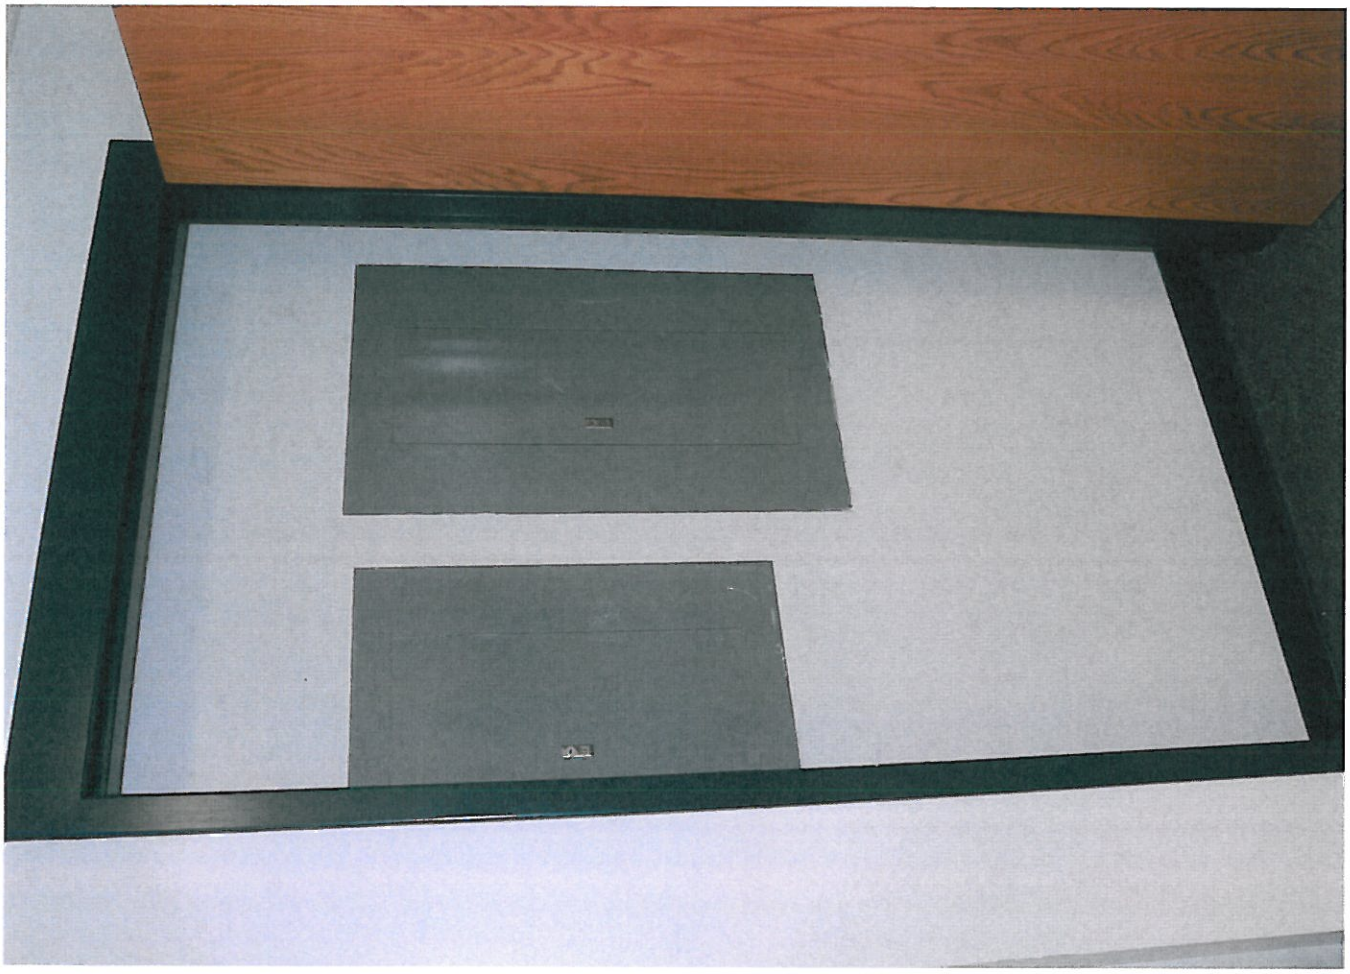


Simplex
INTEGRATED COMMUNICATIONS SYSTEM
CERBERUS

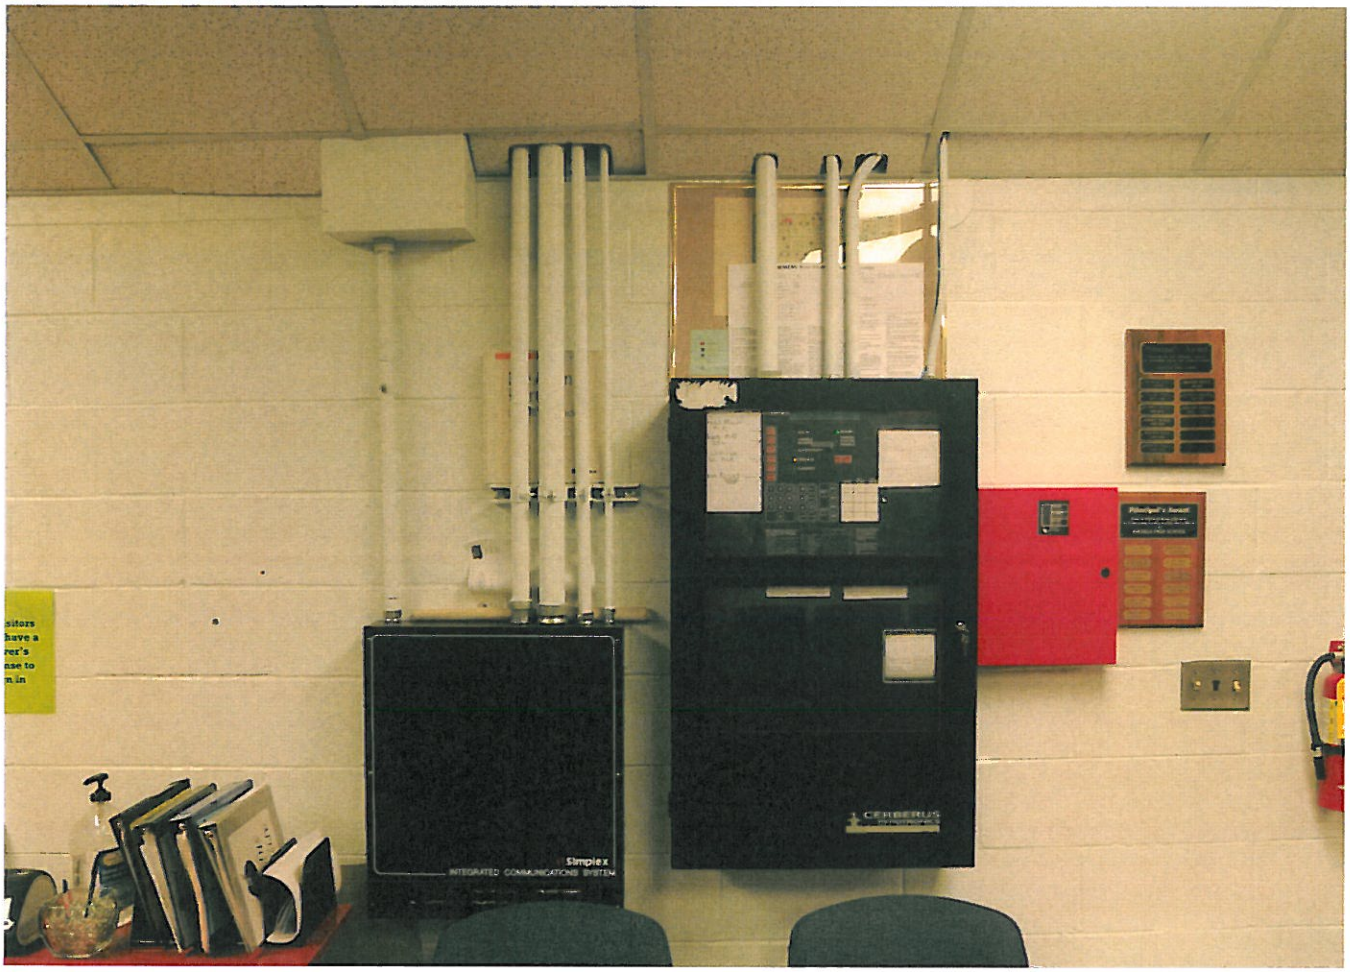
Simplex
INTEGRATED COMMUNICATIONS SYSTEM
CERBERUS

